



MOA ARCHITECTURE
WYOMING | COLORADO

259 S. CENTER STREET, SUITE 206
CASPER, WYOMING 82601
307.268.9890
moearch.com

CASPER COLLEGE LOCKER ROOMS
1944 LUSCO DR, CASPER, WY 82601



Addendum 01	2026-03-06
REVISION	DATE

FOR PERMIT AND CONSTRUCTION

Project Number	24108.00
Date	2026-02-13
Drawn By	KB
Checked By	BA

Covered:
ALL DRAWING AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE

Sheet Name	SPECIFICATIONS
------------	----------------

G-002.6

E. Hardware Adjustment:

1. Adjust and lubricate hardware for proper operation.
2. Set the surface mounted spring hinges on inswing doors to hold open approximately 20 degrees from closed position when unlatched.
3. Set the surface mounted spring hinges on out-swing doors (and entrance swing doors) to return to fully closed position.

3.02 CLEANING

- A. Clean and Protect: Clean exposed surfaces of partition parts using materials and methods recommended by manufacturer and provide protection as necessary to prevent damage during remainder of construction period.
- B. Scratch Removal: Sand or buff out scratches per methods recommended by manufacturer.

END OF SECTION

1.03 REFERENCES

- A. American National Standards Institute (ANSI)
- B. American Society of Testing and Materials (ASTM)
- C. International Cast Polymer Alliance (ICPA)
- D. National Fire Protection Association (NFPA)

1.04 SYSTEM DESCRIPTION

- A. Performance Requirements: Provide solid surface material that conforms to ANSICIPA SS-1, Performance Standard for Solid Surface Materials for workmanship and finish, structural integrity and material characteristics.
 1. Fungal and Bacterial Resistance: Provide a solid surface material that does not support fungal and bacterial growth as tested in accordance with ASTM G21 and ASTM G22.
 2. Fire Performance Characteristics: Provide a solid surface material conforming with the NFPA class A fire rating as determined by ASTM E84.

1.05 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification sections.
 - B. Product data for materials and installation including anchors, hardware, fasteners, and accessories.
 - C. Shop drawings for installation of Partition assemblies that are not fully described by architectural drawings. Provide layouts and installation instructions.
 - D. Samples: Verification samples minimum 1.5' x 3' samples indicating color and pattern.

1.06 QUALITY ASSURANCE

- A. Field Measurements: Take field measurements prior to component fabrication to ensure proper fitting of work.
- B. Coordination: Manufacturer to provide standard fasteners. Installer is to confirm and provide appropriate fasteners for field conditions to install Toilet Partitions and related items.

1.07 DELIVERY STORAGE AND HANDLING

- A. Deliver materials in unopened factory packaging to the jobsite.
- B. Inspect materials at delivery to ensure that specified products have been received.
- C. Store in original packaging in an interior climate controlled location away from direct sunlight.

1.08 PROJECT CONDITIONS

- A. Environmental Requirements: Products must be installed in an interior climate controlled environment.

1.09 WARRANTY

- A. Standard Prism™ Solid Surface Partition Limited 5 Year Warranty against material and manufacturing defects.

PART 2 – PRODUCTS

2.01 MANUFACTURER

- A. Basis-Of-Design Product: Inpro Corporation, Endurant PO Box 406 Muskego, WI 53150 USA; Telephone: 800.222.5556, Fax: 888.715.8407, Website: www.inprocorp.com.

2.02 DESCRIPTION

- A. General: Provide Toilet Partition, Doors, Wall Panels, & Pilasters that are fabricated from Prism™ Solid Surface material bonded to a moisture resistant wood reinforced core. Edges shall be fabricated from a matching solid surface material. All seams and glue lines will be inconspicuous. All doors, panels, and pilasters shall be 1" (25.4mm) finished thickness. Doors, panels, and pilasters shall be assembled into complete compartment system.

2.03 MANUFACTURED UNITS

- A. Toilet Compartments/Partitions, floor mounted with overhead bracing.
 1. Door Size – 32"x68", 22-48" widths and 58-84" heights (18 SQ FT MAX)
 2. Panel Size – 68"x63", 84" maximum length or width, not to exceed 60 1/2" in both directions (30 SQ FT MAX)
 3. Pilaster width – 3"-10" (1-inch increments)
 4. Pilaster Height – 83" Standard up to 96"

2.04 MATERIALS

- A. Prism Solid Surface Toilet Partition Panels:
 1. Prism™ Solid Surface sheet shall be 1/4" (6.35mm) thick. Material shall be manufactured from polyester/acrylic blended resins with natural fiber material.
 2. Core Material: Core material of 1/2" (13mm) thickness shall be moisture resistant wood reinforced core.
 3. Edge and seam adhesives: Seams shall be bonded with methyl methacrylate adhesive matching in pigmentation to the face and edge material. All seam and glue lines will be inconspicuous.
 4. Stainless Steel: Stainless steel pilaster shoes and caps and brackets shall be type 304 Stainless Steel with #4 Satin Finish.
 5. Aluminum: Aluminum headrails shall be continuous extruded aluminum, anti-grip profile, with a clear anodized satin finish.
 6. Exposed Fasteners: Exposed fasteners shall be tamper resistant and stainless steel.
 7. Concealed Fasteners: Concealed fasteners shall be zinc plated steel.

2.05 FINISHES

- A. Color: Frosted White P9711

2.06 ACCESSORIES

- A. Pilaster Shoes
 1. Stainless steel shoes (Standard), 22 gauge, Type #304 stainless steel, #4 Satin finish.
 - a. 4" Height, 3" to 10" (1-inch increments), 10' to 24' (2-inch increments).
- B. Trim
 1. Full Trim Package
 - a. Provide solid surface trim that conceals brackets except hinges, and blocks line of sight at door opening.

D. Hinges

1. Hinge – 58" high doors or less – 3 hinges, 59 - 84" high doors – 4 hinges - surface spring 4" x 3/32", stainless steel –satin finish
2. Piano Hinge-Cam 57-1/2" long (full close), stainless steel –satin finish
3. Piano Hinge-Cam 71" long (full close), stainless steel –satin finish

E. Latches

1. Latch Slide - surface mounted – stainless steel –satin finish
2. Strike - 1" Door - stainless steel – satin finish
3. Continuous Strike – 54" long – aluminum – clear anodized
4. Keeper - stainless steel – satin finish
5. Emergency Access Indicator Latch

F. Throws

1. Latch-Throw – stainless – satin finish
2. Strike - 1" Door - stainless steel – satin finish
3. Continuous Strike – 54" long – aluminum – clear anodized
4. Throw Latch Pack - ADA compliant latch – stainless steel – satin finish

G. Hooks

1. Hook-combination bumper, satin stainless steel

H. Pulls

1. Door Pull 3-1/2" centers - Cast stainless steel

I. Headrails (Overhead Bracing)

1. Continuous extruded aluminum, anti-grip profile, with clear anodized satin finish. Headrail returns as shown on shop drawings.
 - a. Headrail - 8-1/2"
 - b. Headrail - 10"

2.07 FABRICATION

- A. General: Furnish standard doors, panels, and pilasters fabricated for partition system.
- B. Door Dimensions: Unless otherwise indicated, furnish 24" wide in-swing doors for ordinary toilet partitions and minimum 32" wide (clear opening) out-swing doors for partitions that meet the requirements of the Americans with Disabilities Act (ADA).
- C. Toilet Partitions:
 1. Solid Surface with Moisture Resistant Wood Reinforced Core: material shall be processed and fabricated in a craftsman like manner. All surfaces shall have Inpro's final finish. Seams shall be tightly bonded. All seam and glue lines will be inconspicuous. Edges shall be finished and free of milling marks.

PART 3 – EXECUTION

3.01 INSTALLATION

- A. General: Install in accordance with manufacturer's instructions.
 1. Install compartment units rigid, straight, plumb and level.
 2. Provide clearance of not more than 1/2 inch (13 mm) between pilasters and panels and not more than 1 inch (25.4 mm) between panels and structural walls.
 3. Secure panels to walls with three brackets for walls up to 58" high, and 4 brackets for walls 59" – 84" high, attached near top, middle and bottom of panel or one continuous bracket, centered.
 4. Locate wall brackets so holes for wall anchorages occur in masonry or tile joints.
 5. Secure panels to pilasters with three brackets for walls up to 58" high, and 4 brackets for walls 59" – 84" high, located to align with brackets at wall.
 6. Secure panels in position with anchoring devices.
 7. Level, plumb, and tighten installation.

B. Floor Mounted Overhead Braced Compartments:

1. Secure pilaster to floor. Secure overhead brace to each pilaster with fasteners supplied.
2. Attach wall panels to structural walls and pilasters with supplied hardware.
3. Hang doors and adjust so tops of doors are parallel with overhead brace when doors are in closed position.

E. Partition Head to Structure Connections: Provide mechanical anchorage devices that accommodate deflection using slotted holes, screws, and anti-friction bushings, preventing rotation of studs while maintaining structural performance of partition and preventing cracking of gypsum board applied to interior partitions resulting from deflection of structure above wall; thickness and width to match studs.

1. Structural Performance: Maintain lateral load resistance and vertical movement capacity required by applicable code, when evaluated in accordance with AISI S100.
2. Material: ASTM A653/A653M steel sheet, SS Grade 50/340, with G60/Z180 hot-dipped galvanized coating.
3. Provide Components UL-listed for use in UL-listed fire-resistance-rated head of partition joint systems specified in Section 07 84.00.
4. Provide mechanical anchorage devices as described above that accommodate deflection while maintaining the fire-resistance rating of the wall assembly.
5. Use minimum 3 inch deep lag track for non-rated top of wall slip joints where indicated.

F. Non-structural Framing Accessories:

1. Ceiling Hangers: Type and size as specified in ASTM C754 for spacing required.
- G. Grid Suspension Systems: Steel grid system of main tees and support bars connected to structure using hanging wire.
 1. Products:
 - a. USG Corporation: Drywall Suspension System: www.usg.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.03 CEILING SUSPENSION SYSTEM COMPONENTS

- A. Gypsum Board Interior Ceiling Suspension System.
 1. Ceiling Hanger Wire: ASTM A641/A641M, Class 1 coating; soft temper, pre-stretched, yield stress load at least three times design load, but not less than 12 gage.

2.04 BOARD MATERIALS

- A. Manufacturers - Gypsum-Based Board:
 1. American Gypsum Company: www.americangypsum.com/#sle.
 2. CertainTeed Corporation: www.certainteed.com/#sle.
 3. Georgia-Pacific Gypsum: www.gypgypsum.com/#sle.
 4. National Gypsum Company: www.nationalgypsum.com/#sle.
 5. USG Corporation: www.usg.com/#sle.
 6. Substitutions: See Section 01 6000 - Product Requirements.
- B. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
 1. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - a. Mold resistant board is required at all locations.
 3. At Assemblies Indicated with Fire-Resistance Rating: Use type required by indicated tested assembly; if no tested assembly is indicated, use Type X board, UL or WH listed.
 4. Thickness: As indicated on Drawings.

DIVISION 10 - SPECIALTIES

10 2613 CORNER GUARDS

PART 1 – GENERAL

1.01 SUMMARY

- A. Section Includes:
 1. Metal corner guards, paintable finish.
 2. Accessories required for complete installation.
- B. Related Sections:
 1. Section 09 91 23 – Interior Painting: Field-applied paint finishes.
 2. Section 09 29 00 – Gypsum Board: Substrate for corner guard installation.
 3. Section 10 26 16 – Wall and Door Protection Panels (if used in combination).

1.02 REFERENCES

- A. ASTM A240/A240M – Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip.
- B. ASTM B209 – Aluminum and Aluminum-Alloy Sheet and Plate.
- C. ASTM D3359 – Standard Test Methods for Measuring Adhesion by Tape Test.
- D. SSPC-SP 1 – Solvent Cleaning.

1.03 SUBMITTALS

- A. Product Data: Manufacturer's technical data, installation instructions, and maintenance recommendations.
- B. Samples: Minimum 6-inch long sample, showing profile, material, and factory primer for paint.
- C. Shop Drawings (when required): Indicate locations, mounting details, and termination conditions.
- D. Maintenance Data: For incorporation into O&M manuals.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Minimum 5 years' experience producing wall protection products.
- B. Installer Qualifications: Experienced installer with minimum 3 similar installations.
- C. Mock-Up:
 1. Install one corner guard at location designated by Architect.
 2. Accepted mock-ups remain as part of Work.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials in manufacturer's original protective packaging.
- B. Store doors, elevated above floor, protected from moisture and physical damage.
- C. Handle materials in a manner to prevent damage to edges and finish.

1.06 WARRANTY

- A. Manufacturer's standard 1-year warranty against material and manufacturing defects.
- B. Warranty does not cover damage due to abuse, improper installation, or failure of substrate.

PART 2 – PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design: Inpro Corporation; Model: G2 Series Tape-On Rigid Vinyl Corner Guards.
- B. Acceptable Manufacturers:
 1. Inpro Corporation.
 2. Construction Specialties (CS Group).
 3. [Insert Local or Regional Manufacturer].
- C. Substitutions: Per Section 01 25 00 – Substitution Procedures.

2.02 MATERIALS

- A. Metal Corner Guards:
 1. Material Options (select one):
 - a. Aluminum sheet, ASTM B209, minimum 0.063 inch (1.6 mm) thick.
 - b. Stainless steel, ASTM A240, minimum 18 gage.
 2. Profile:
 - a. 90-degree angle.
 - b. Standard leg length: 1-1/2 inch (38 mm).
 - c. Optional sizes: 2 inch (51 mm), 3 inch (76 mm).
 3. Height: Full wall height unless otherwise indicated.
 4. Edges: Square or slightly eased, free of burrs.
- B. Finish:
 1. Factory primed for field-applied paint finish.
 2. Primer compatible with latex and alkyd paints.
 3. Color: To match adjacent wall finish (painted in field).

2.03 ACCESSORIES

- A. Fasteners: Manufacturer's standard, concealed where possible, suitable for substrate.
- B. Adhesive (optional): Manufacturer's recommended adhesive compatible with substrate and finish.
- C. Edge Trim: As required for neat termination where corner guards do not extend to floor or ceiling.

PART 3 – EXECUTION

3.01 EXAMINATION

- A. Verify substrate surfaces are clean, dry, and smooth prior to installation.
- B. Correct unsatisfactory conditions prior to beginning work.

3.02 PREPARATION

- A. Remove loose materials and debris from substrate corners.
- B. Prime substrate surfaces as required by manufacturer for adhesive installation.

3.03 INSTALLATION

- A. Install corner guards in accordance with manufacturer's instructions.
- B. Locate as indicated on drawings; set plumb, straight, and tight to substrate.
- C. Provide uniform contact along entire length of corner guard.
- D. Secure with concealed fasteners or adhesive, unless otherwise indicated.

3.04 FIELD FINISHING

- A. Prepare primed metal surface in accordance with paint manufacturer's recommendations.
- B. Apply paint finish per Section 09 91 23 to match adjacent wall finish.
- C. Ensure coating adhesion per ASTM D3359.

3.05 CLEANING AND PROTECTION

- A. Clean surfaces of adhesives, dust, and construction debris.
- B. Protect installed work from damage during remainder of construction.
- C. Replace damaged or defective work prior to Substantial Completion.

END OF SECTION

SECTION 10 2123

TOILET PARTITIONS

PART 1 – GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
- 1.02 SUMMARY
 - A. Section includes stock and manufactured toilet partitions with Prism™ Solid Surface exterior and moisture resistant wood reinforced core.
 1. Doors, Walls, & Pilasters: Prism™ Solid Surface with moisture resistant wood reinforced core.
 2. Construction styles of Toilet Partitions include:
 1. Floor Mounted, Overhead Braced

- A. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- C. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
 1. Wood: 15 percent, measured in accordance with ASTM D4442.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces for finishing.
- D. Wood Surfaces to Receive Opaque Finish: Wipe off dust and grit prior to priming. Seal knots, pitch streaks, and sappy sections with sealer. Fill nail holes and cracks after primer has dried; sand between coats. Back prime concealed surfaces before installation.
- E. Wood Surfaces to Receive Transparent Finish: Wipe off dust and grit prior to sealing, seal knots, pitch streaks, and sappy sections with sealer. Fill nail holes and cracks after sealer has dried; sand lightly between coats. Prime concealed surfaces with gloss varnish reduced 25 percent with thinner.
- F. Wood Doors to be Field-Finished: Seal wood door top and bottom edge surfaces with clear sealer.

3.03 APPLICATION

- A. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- B. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- C. Apply each coat to uniform appearance in thicknesses specified by manufacturer.
- D. Sand wood surfaces lightly between coats to achieve required finish.
- E. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- F. Wood to Receive Transparent Finishes: Tint fillers to match wood. Work fillers into the grain before set. Wipe excess from surface.
- G. Reinstall items removed prior to finishing.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements for general requirements for field inspection.

3.05 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.06 PROTECTION

- A. Protect finishes until completion of project.
- B. Touch-up damaged finishes after Substantial Completion.

END OF SECTION

1.02 REFERENCE STANDARDS

- A. AISI S100 - North American Specification for the Design of Cold-Formed Steel Structural Members; 2016, with Supplement (2020).
- B. AISI S220 - North American Standard for Cold-Formed Steel Nonstructural Framing; 2020.
- C. AISI S240 - North American Standard for Cold-Formed Steel Structural Framing; 2015, with Errata (2020).
- D. ASTM A641/A641M - Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire; 2019 (Reapproved 2025).
- E. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- F. ASTM A1003/A1003M - Standard Specification for Steel Sheet, Carbon, Metallic- and Nonmetallic-Coated for Cold-Formed Framing Members; 2015.
- G. ASTM C1007 - Standard Specification for Installation of Load Bearing (Transverse and Axial) Steel Studs and Related Accessories; 2020 (Reapproved 2024).
- H. ASTM C475/C475M - Standard Specification for Joint Compounding and Joint Tape for Finishing Gypsum Board; 2017 (Reapproved 2022).
- I. ASTM C754 - Standard Specification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products; 2020.
- J. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board; 2024.
- K. ASTM C954 - Standard Specification for Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness; 2022.
- L. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2022.
- M. ASTM C1047 - Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base; 2019.
- N. ASTM C1396/C1396M - Standard Specification for Gypsum Board; 2024.
- O. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2021.
- P. ASTM E90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements; 2023.
- Q. ASTM E413 - Classification for Rating Sound Insulation; 2022.
- R. GA-216 - Application and Finishing of Gypsum Panel Products; 2024.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate the installation of gypsum board assemblies with size, location, and installation of service utilities.
- B. Coordinate with mechanical and electrical work. Do not attach or support metal framing to ducts, pipes, conduit, or similar items.
- C. Coordinate installation of ceiling suspension system with installation of overhead structural systems to ensure that inserts and other structural anchorage provisions have been installed to receive ceiling anchors in a manner that will develop their full strength and at spacing required to support ceiling.
- D. Preinstallation Meeting: Conduct a preinstallation meeting one week prior to the start of the work of this section; require attendance by all affected installers.
- E. Sequencing: Install service utilities in an orderly and expeditious manner.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data:
 1. Provide data on metal framing, gypsum board, accessories, and joint finishing system.
 2. Provide manufacturer's data on partition head to structure connectors, showing compatibility with requirements.
 3. Shop Drawings: Indicate special details associated with acoustic seals.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the types of products specified in this section, and with a minimum five years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.
- C. Copies of Documents at Site: Maintain at the project site a copy of each referenced document that prescribes execution requirements.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Store gypsum products and accessories indoors and keep above freezing. Elevate boards above floor, on nonworking supports, in accordance with manufacturer's recommendations.
- B. Store metal products to prevent corrosion, under cover and above grade.
- C. Handle gypsum boards to prevent damage to ends, edges, and surfaces.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperatures at not less than 40 degrees F for non-adhesive attachment of gypsum board, and not less than 50 degrees F for adhesive attachment.
- B. Maintain ambient temperatures at not less than 50 degrees F for a period 48 hours before gypsum board finishing, during installation, and after installation of board materials.

PART 2 PRODUCTS

2.01 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
- B. Interior Partitions, Indicated as Acoustic: Provide completed assemblies with the following characteristics:
 1. Acoustic Attenuation: STC of 45-49 calculated in accordance with ASTM E413, based on tests conducted in accordance with ASTM E90.


2.02 METAL FRAMING MATERIALS

- A. Steel Sheet: ASTM A1003/A1003M, subject to the ductility limitations indicated in AISI S220 or equivalent.
- B. Manufacturers - Metal Framing, Connectors, and Accessories:
 1. ClarkDietrich: www.clarkdietrich.com/#sle.
 2. Phillips Manufacturing Co: www.phillipsmf.com/#sle.
 3. SCAFCO Corporation: www.scafcoc.com/#sle.
 4. Steel Construction Systems: www.steelconstsystems.com/#sle.
 5. CEMCO, California Expanded Metal Company: www.cemcosteel.com.
 6. Substitutions: See Section 01 6000 - Product Requirements.
- C. Metal Framing - General: Provide framing materials complying with specified standards and tested assemblies; galvanized sheet steel, 25 gage unless specified, noted, scheduled, or detailed otherwise.
 1. Use minimum 20 gage studs at door jambs and tile backing support and other locations indicated.
 2. Use minimum 16 gage studs at double door jambs.
- D. Non-structural Framing System Components: ASTM C645; galvanized sheet steel, of size and properties necessary to comply with ASTM C754 for the spacing indicated, with maximum deflection of wall framing of L/240 at 5 psf.
 1. Studs: C-shaped with knurled or embossed faces.
 2. Runners: U shaped, sized to match studs.
 3. Ceiling Channels: C-shaped.
 4. Furring Members: Hat-shaped sections, minimum depth of 7/8 inch.
 5. Stud System Accessories: Manufacturer's standard clips, shoes, ties, reinforcements, fasteners, and other accessories as required for a complete stud framing system.



CODE REVIEW 2024 ICC

JURISDICTION	Casper, WY																																			
CODES	2024 International Building Code 2024 International Mechanical Code 2024 International Plumbing Code 2022 National Electrical Code 2024 International Fire Code 2024 International Existing Building Code 2017 ICC A117.1, Accessible and Usable Buildings and Facilities (BC - Chapter 35) Americans with Disabilities Act (ADA)																																			
PROJECT DESCRIPTION	FOLLOWING ARE THE PLAN OUTLINING THE SCOPE OF WORK REQUIRED FOR AN APPROX. 2,800 SQ. FT INTERIOR RENOVATION PROJECT. THERE IS NO PROPOSED CHANGE-OF-USE. WORK TO INCLUDE CONSTRUCTION OF NEW NON-STRUCTURAL PARTITIONS, CEILINGS, FINISHES, MECHANICAL, PLUMBING AND ELECTRICAL.																																			
BUILDING AREA	MAIN LEVEL - 38,200 GSF (EXISTING) UPPER LEVEL - 6,500 GSF (EXISTING BLEACHER SEATING ONLY)																																			
AREA OF WORK	2,800 GSF AREA OF WORK (7.7% OF MAIN LEVEL SQUARE FOOTAGE)																																			
NO. OF STORIES	2 (EXISTING; UPPER LEVEL IS BLEACHER SEATING ONLY)																																			
BUILDING HEIGHT	EXISTING																																			
ITEM OCCUPANCY CLASSIFICATIONS	A-5, A-4, A-3, B, S-2 - NO CHANGES TO OCCUPANCY CLASSIFICATION	CODE CITATION SECTIONS 303.4, 303.5, 303.6, 304.1 & 311.3																																		
OCCUPANCY SEPARATION	AREAS OF RENOVATION DOES NOT INCLUDE WORK AT SEPARATE OCCUPANCIES. MAINTAIN ANY EXISTING RATING OF VERTICAL AND HORIZONTAL ASSEMBLIES.																																			
OCCUPANT LOAD	THERE ARE NO CHANGES TO OCCUPANT LOAD AS A PART OF THIS PROJECT. ONLY RECONFIGURATION OF SPACES.																																			
IEBC ALTERATION		IEBC 602 & 603 CHAPTER 7 & CHAPTER 8																																		
LEVEL 1 ALTERATION	LEVEL 1 ALTERATION INCLUDE THE REMOVAL AND REPLACEMENTS OR THE COVERING OF EXISTING MATERIALS, ELEMENTS, EQUIPMENT OR FIXTURES USING NEW MATERIALS, ELEMENTS, EQUIPMENT OR FIXTURES THAT SERVE THE SAME PURPOSE.																																			
LEVEL 2 ALTERATION	LEVEL 1 ALTERATION INCLUDE THE ADDITION OF ELIMINATION OF ANY DOOR OR WINDOW, THE RECONFIGURATION OR EXTENSION OF ANY SYSTEM OR THE INSTALLATION OF ANY ADDITIONAL EQUIPMENT, AND SHALL APPLY WHERE THE WORK AREA IS EQUAL TO OR LESS THAN 50 PERCENT OF THE BUILDING AREA.																																			
CONSTRUCTION	II-B (EXISTING)	SECTION 602 & TABLE 601																																		
FIRE PROTECTION	FIRE SPRINKLERING EXISTING FIRE SUPPRESSION SYSTEM TO REMAIN FIRE EXTINGUISHERS EXISTING CLASS ABC EXTINGUISHERS TO REMAIN FIRE ALARM EXISTING FIRE ALARM SYSTEM TO REMAIN																																			
EXITS	NUMBER OF EXITS FROM SPACES: THERE ARE NO CHANGES TO EXITING OR NUMBER OF EXITS AS PART OF THIS PROJECT. MAINTAIN EGRESS AT ALL TIMES DURING CONSTRUCTION.																																			
NUMBER OF EXITS FROM STORIES:	THERE ARE NO CHANGES TO THE NUMBER OF EXITS FROM THE UPPER LEVEL AS PART OF THIS PROJECT. MAINTAIN EGRESS AT ALL TIMES DURING CONSTRUCTION.																																			
SEPARATION OF EXITS	THERE ARE NO CHANGES TO THE REQUIREMENT OF SEPARATION OF EXITS AS A PART OF THIS PROJECT. MAINTAIN EGRESS AT ALL TIMES DURING CONSTRUCTION.																																			
COMMON PATH OF EGRESS TRAVEL	75 FT MAX.	TABLE 1006.2.1																																		
EXIT ACCESS TRAVEL DISTANCE	<table border="1"> <thead> <tr> <th>PATH ID</th> <th>TYPE</th> <th>LENGTH</th> </tr> </thead> <tbody> <tr> <td>Path A</td> <td>Common Path</td> <td>39'</td> </tr> <tr> <td>Path B</td> <td>Common Path</td> <td>40'</td> </tr> <tr> <td>Path C</td> <td>Common Path</td> <td>34'</td> </tr> </tbody> </table>		PATH ID	TYPE	LENGTH	Path A	Common Path	39'	Path B	Common Path	40'	Path C	Common Path	34'																						
PATH ID	TYPE	LENGTH																																		
Path A	Common Path	39'																																		
Path B	Common Path	40'																																		
Path C	Common Path	34'																																		
PLUMBING FIXTURES	NOTE: THE EXISTING OCCUPANT LOAD AND EXISTING FIXTURE COUNT DO NOT INCLUDE LOCKER ROOMS. LOCKER ROOMS ARE NOT AVAILABLE TO THE GENERAL BUILDING OCCUPANTS. LOCKER ROOMS ARE SELF SUFFICIENT FROM A FIXTURE COUNT STANDPOINT. NO CHANGES ARE PROPOSED TO THE OCCUPANT LOADS OR PLUMBING FIXTURES AT THE NOT-IN-SCOPE AREAS OF THE BUILDING.																																			
	<table border="1"> <thead> <tr> <th rowspan="2">ROOM</th> <th rowspan="2">OCCUPANT LOAD</th> <th colspan="2">TOILETS</th> <th colspan="2">URINALS</th> <th colspan="2">LAVS</th> </tr> <tr> <th>REQUIRED</th> <th>PROVIDED</th> <th>PROVIDED</th> <th>REQUIRED</th> <th>PROVIDED</th> </tr> </thead> <tbody> <tr> <td>WOMENS BASKETBALL</td> <td>13 OCC (1/50 SF)</td> <td>13/65+0.2</td> <td>2</td> <td>N/A</td> <td>13/200+0.065</td> <td>2</td> </tr> <tr> <td>NORTH FLEX LOCKER</td> <td>9 OCC (1/50 SF)</td> <td>9/65+0.14</td> <td>2</td> <td>N/A</td> <td>9/200+0.045</td> <td>2</td> </tr> <tr> <td>WOMENS VOLLEYBALL</td> <td>12 OCC (1/50 SF)</td> <td>12/65+0.18</td> <td>2</td> <td>N/A</td> <td>12/200+0.06</td> <td>2</td> </tr> </tbody> </table>		ROOM	OCCUPANT LOAD	TOILETS		URINALS		LAVS		REQUIRED	PROVIDED	PROVIDED	REQUIRED	PROVIDED	WOMENS BASKETBALL	13 OCC (1/50 SF)	13/65+0.2	2	N/A	13/200+0.065	2	NORTH FLEX LOCKER	9 OCC (1/50 SF)	9/65+0.14	2	N/A	9/200+0.045	2	WOMENS VOLLEYBALL	12 OCC (1/50 SF)	12/65+0.18	2	N/A	12/200+0.06	2
ROOM	OCCUPANT LOAD	TOILETS			URINALS		LAVS																													
		REQUIRED	PROVIDED	PROVIDED	REQUIRED	PROVIDED																														
WOMENS BASKETBALL	13 OCC (1/50 SF)	13/65+0.2	2	N/A	13/200+0.065	2																														
NORTH FLEX LOCKER	9 OCC (1/50 SF)	9/65+0.14	2	N/A	9/200+0.045	2																														
WOMENS VOLLEYBALL	12 OCC (1/50 SF)	12/65+0.18	2	N/A	12/200+0.06	2																														
OTHER REQUIREMENTS AND PROVISIONS	<p>ACCESSIBILITY ACCESSIBILITY IMPROVEMENTS TO THIS PROJECT INCLUDE ADA COMPLIANT TOILETS, LAVS, SHOWERS AND COLD THERAPY TUBS. CHAPTER 11, ANSICC A117.1, ADA</p> <p>ACCESSIBLE MEANS OF EGRESS SECTION 1009 & ICC A117.1 403</p> <p>ACCESSIBLE TOILET ROOMS SECTION 1110.2 & ANSICC A117.1 603 MINIMUM OF 1 ACCESSIBLE STALL PER TOILET ROOM SECTION 1110.2.4 MINIMUM OF 5% OF LAVS MUST BE ACCESSIBLE BUT NO LESS THAN ONE IN EACH TOILET ROOM SECTION 1110.2.5</p> <p>SINKS, 5% IF MORE THAN 1, MINIMUM OF 1 ACCESSIBLE SECTION 1110.3 & ANSICC A117.1 606</p> <p>SHOWER COMPARTMENTS SECTION ANSICC A117.1 608</p> <p>ACCESSIBLE LOCKER ROOMS SECTION 1110.17 & ANSICC A117.1 608</p> <p>ACCESSIBLE COLD BATHS SECTION 1111.4.14 EXCEPTION 2</p> <p>ACCESSIBLE COLD BATHS WHERE COLD BATHS ARE PROVIDED IN A CLUSTER, AT LEAST 5 PERCENT, BUT NOT LESS THAN ONE OF EACH TYPE OF COLD BATH IN EACH CLUSTER SHALL BE ACCESSIBLE AND ON A ACCESSIBLE ROUTE.</p> <p>DOORS, GATES & TURNSTILES SECTION 1010 MINIMUM CLEAR WIDTH = 32" SECTION 1010.1.1 PROJECTION INTO CLEAR WIDTH SECTION 1010.1.1.1 LANDINGS AT DOORS SECTION 1010.1.5 THRESHOLDS SECTION 1010.1.6</p> <p>INTERIOR WALL AND CEILING FINISH REQUIREMENTS TABLE 803.13 REFER TO TABLE FOR REQUIREMENTS BY OCCUPANCY CLASS C</p> <p>CARBON MONOXIDE DETECTION SECTION 915 SHALL COMPLY WITH NFPA 70, NFPA 72, AND IFC 11.</p> <p>SIGNAGE SECTIONS 1009.9, 1009.10, 1013, 1112 POSTING OF OCCUPANT LOAD SECTION 1004.9</p>																																			

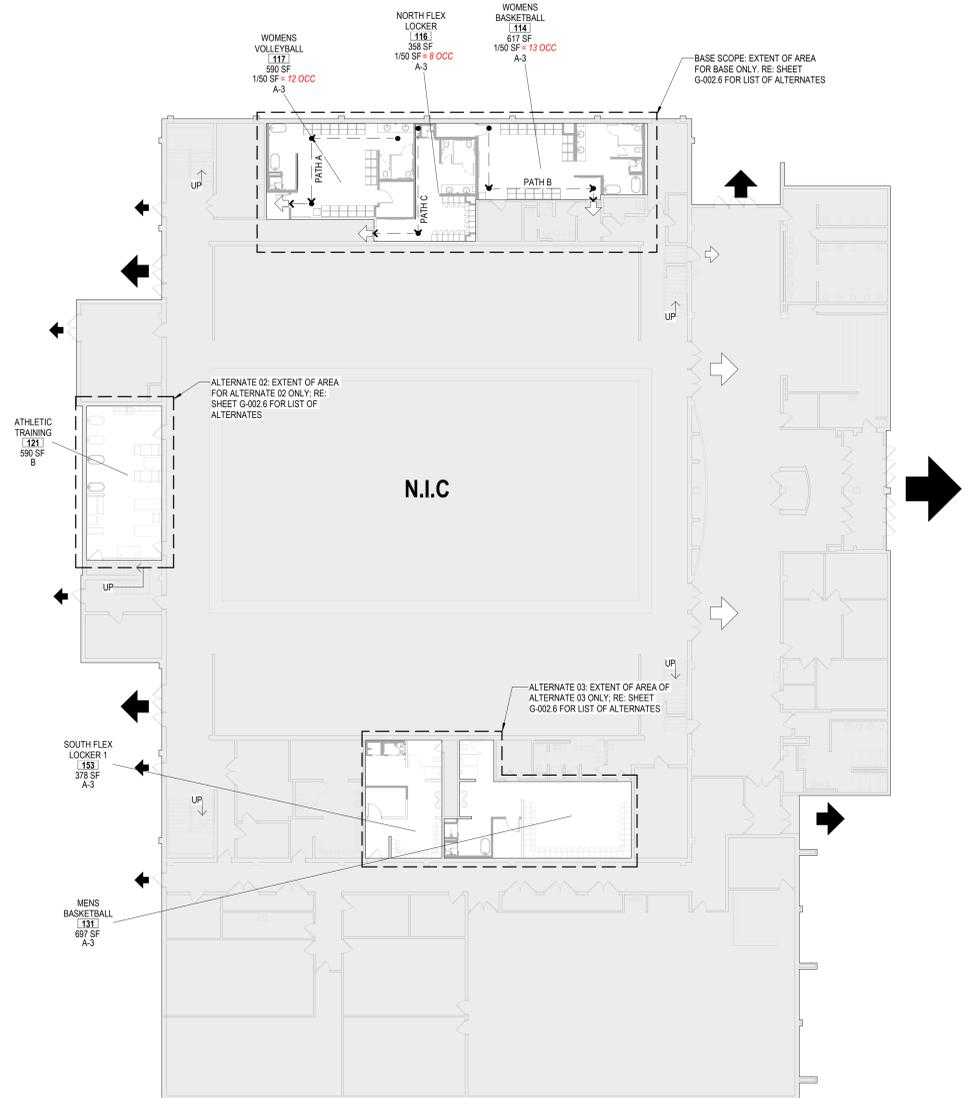

LIFE SAFETY LEGEND



SCOPE LEGEND



Addendum 01	2024-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2024-02-13
Drawn By	KA
Checked By	BD
Copyright:	
ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE	
Sheet Name	CODE COMPLIANCE

GENERAL NOTES


SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION

- DEMOLITION PLAN(S) TO BE USED IN CONJUNCTION WITH THE FLOOR PLAN(S) TO DETERMINE EXACT SCOPE OF DEMOLITION.
- VERIFY THAT ALL ITEMS INDICATED AS EXISTING ARE CORRECT.
- PERFORM ALL DEMOLITION WORK WITH MINIMUM DAMAGE TO THE EXISTING WORK TO REMAIN. EXERCISE THE UTMOST CARE WHILE PERFORMING THE DEMOLITION WORK. PROVIDE BARRICADES WHERE REQUIRED TO PROTECT THE PUBLIC.
- PROTECT GYMNASIUM WOOD FLOOR DURING DEMOLITION AND CONSTRUCTION. DO NOT REMOVE ANY STRUCTURAL COLUMNS, WALLS OR SUPPORTS. CAREFULLY REMOVE INTERIOR PARTITIONS ONLY. IF THERE IS ANY CONCERN WHETHER AN INTERIOR WALL IS BEARING OR NOT, CONTACT ARCHITECT IMMEDIATELY.
- REFER TO PLUMBING, MECHANICAL, ELECTRICAL DRAWINGS FOR SCOPE OF DEMOLITION UNDER EACH DISCIPLINE.
- DEMOLITION OF FLOOR SLAB AND TRENCHING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSFERING OF CONCRETE IRREGULARITIES.
- EXISTING FLOORING THAT IS REMOVED SHALL BE AN ACCEPTABLE SUBSTRATE SMOOTHNESS FOR NEW FLOORING.
- REMOVE AND RETURN TO OWNER ALL WALL MOUNTED ACCESSORIES/SPECIALTIES.
- REMOVE AND RETURN TO OWNER ALL EQUIPMENT/ FURNISHINGS.
- PATCH EXISTING WALLS AND TOUCH UP PAINT AS REQUIRED WHERE DEVICES ARE INSTALLED OR RELOCATED.
- COORDINATE WITH ARCHITECT AND OWNER IF EQUIPMENT, FURNISHINGS OR ACCESSORIES REQUIRE TO BE TEMPORARILY RELOCATED.


SHEET KEYNOTES

NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SKIPPED ON ANY GIVEN DRAWING SHEET.


- REMOVE PLUMBING FIXTURES; RE: PLUMBING
- EXISTING DOOR TO REMAIN; PROTECT DURING DEMOLITION AND CONSTRUCTION
- REMOVE EXISTING FLOORING FINISHES AND PREPARE FOR NEW FLOORING; RE: FINISH PLANS FOR EXTENT AND TYPE OF NEW FLOORING
- REMOVE EXISTING CHASE WALL; COORDINATE WITH MEP FOR EXISTING MEP EQUIPMENT
- REMOVE ALL EXISTING LOCKERS AND RETURN TO OWNER
- REMOVE EXISTING TOILET/ SHOWER PARTITIONS
- REMOVE EXISTING WINDOW AND PREPARE OPENING FOR A NEW MECHANICAL LOCKER; RE: MECHANICAL
- PROTECT AND MAINTAIN EXISTING CEILING/ SOFFIT ABOVE. PATCH AND REPAIR AS REQUIRED DURING NEW CONSTRUCTION. RE: REFLECTED CEILING PLANS
- LINE OF EXTENT BETWEEN EXISTING TO REMAIN FLOORING AND NEW CONSTRUCTION FLOORING; RE: FINISH PLANS
- REFER TO PLUMBING FOR EXTENT OF PIPING DEMOLITION AT SLAB; RE: PLUMBING
- EXISTING FIXTURE TO REMAIN; PROTECT DURING DEMOLITION AND NEW CONSTRUCTION
- EXISTING EQUIPMENT, FURNISHINGS AND ACCESSORIES TO REMAIN; PROTECT DURING DEMOLITION AND NEW CONSTRUCTION. RELOCATE DURING DEMOLITION AND CONSTRUCTION AS REQUIRED
- TEMPORARY REMOVAL OF TOILET PARTITION MAY BE REQUIRED FOR NEW FLOORING CONSTRUCTION; REMOVE AND REINSTALL IF REQUIRED
- REMOVE TILE AND PREPARE WALL FOR NEW TILE FINISH. PATCH, REPAIR AND TOUCH UP AS REQUIRED; RE: INTERIOR ELEVATIONS
- REMOVE AND SAVE FOR REUSE: WHIRLPOOL, COLD THERAPY TUBS
- REMOVE RAISED PLATFORM, HALF WALL AND ALL PLUMBING BENEATH RE: PLUMBING FOR EXTENT OF PLUMBING REMOVAL
- REMOVE PORTION OF EXISTING MASONRY WALL FOR NEW DOOR FRAME, SLAB AND HARDWARE; RE: DOOR SCHEDULE
- CAREFULLY DEMOLISH PORTIONS OF EXISTING WALL WHERE NEW WALL OR EXPOSED EDGES WILL BE PRESENT AFTER DEMO. ENSURE EXPOSED WALL EDGE IS PLUMB AND SQUARE TO RECEIVE NEW WALL FINISH
- CAREFULLY REMOVE DOOR FRAME, SLAB, AND HARDWARE FOR REUSE; RETURN TO OWNER IF NOT USED IN NEW CONSTRUCTION PLAN
- REMOVE EXISTING WINDOW AND PATCH WITH NEW MASONRY INFILL. MATCH INTERIOR AND EXTERIOR MASONRY AND GROUT

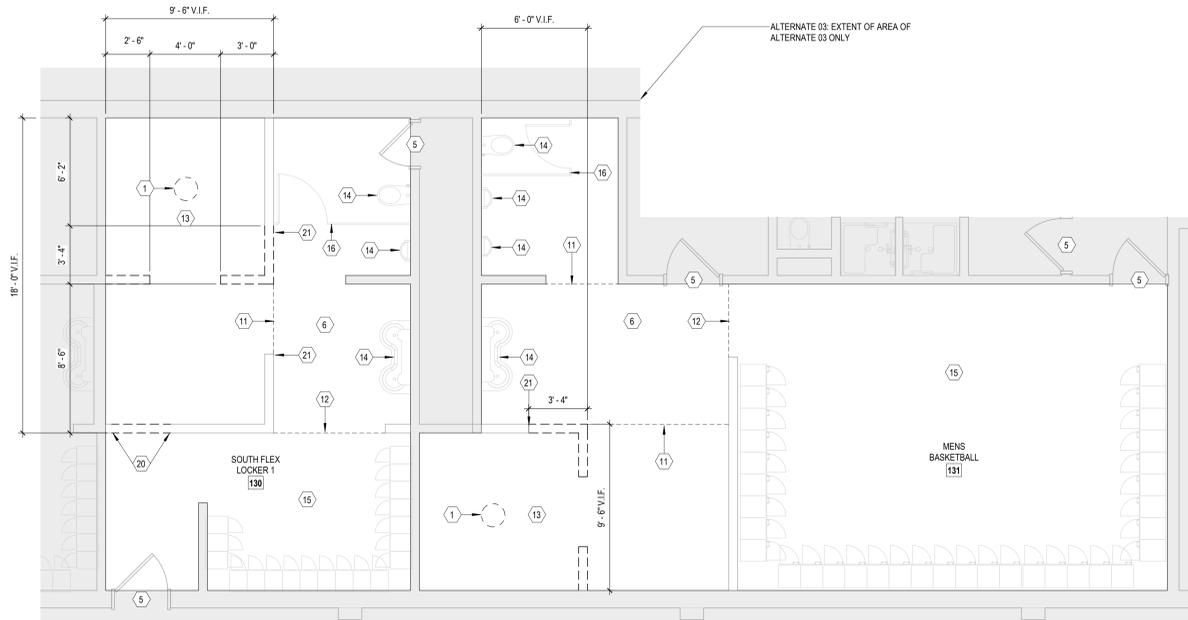

3 ENLARGED DEMOLITION PLAN - SOUTH LOCKERS - ALTERNATE 03
 1/4" = 1'-0"

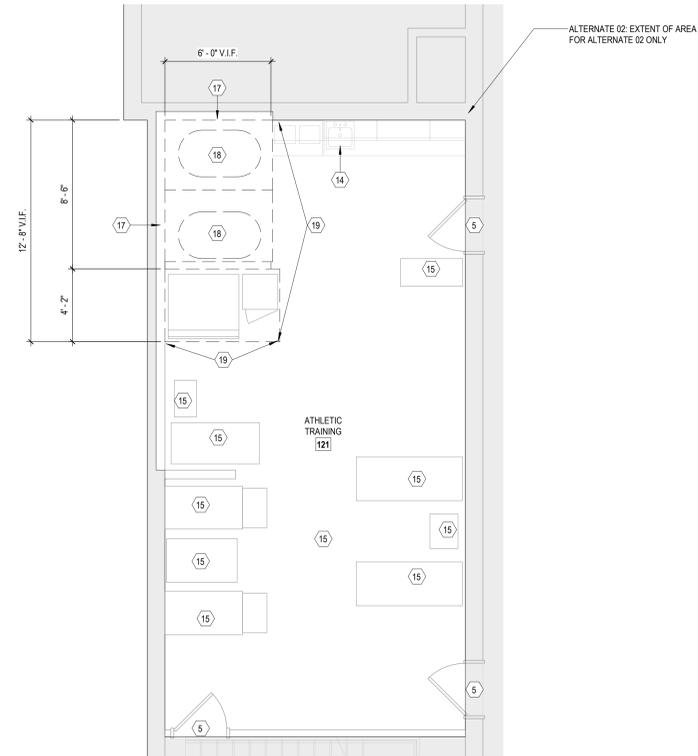

2 ENLARGED DEMOLITION PLAN - ATHLETIC TRAINING - ALTERNATE 02
 1/4" = 1'-0"

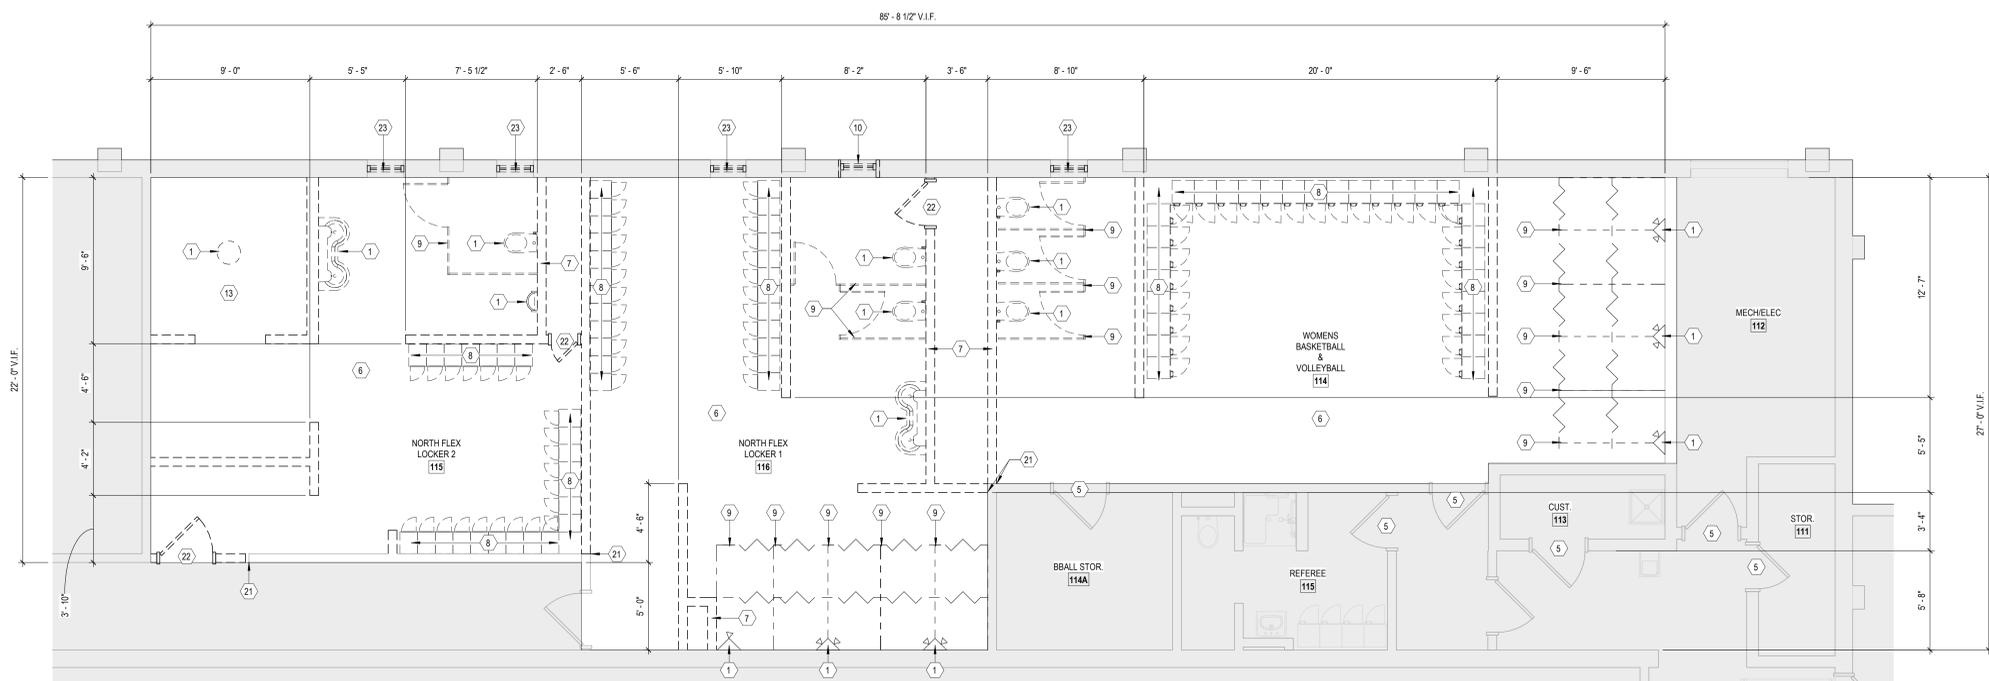

1 ENLARGED DEMOLITION PLAN - NORTH LOCKERS
 1/4" = 1'-0"

CASPER COLLEGE LOCKER ROOMS
 1944 LISCO DR, CASPER, WY 82601



Revision 01	2026-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2026-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE

Sheet Name
 ENLARGED DEMOLITION FLOOR PLAN




AD-102

CONSTRUCTION GENERAL NOTES

1. SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION
2. INTERIOR BUILDING DIMENSIONS ARE TO GRID CENTERLINE AND FACE OF STUD FRAMING AT NEW CONSTRUCTION AND FROM FACE OF EXISTING BUILDING ELEMENT TO FACE OF STUD, UNO.
3. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORIES, NO EXCEPTIONS.
4. ALL INTERIOR FRAMED WALL ASSEMBLIES TO BE TYPE P3 TO BOTTOM OF DECK, UNO.
5. ALL INTERIOR MASONRY WALL ASSEMBLIES ARE EXISTING, UNO.
6. OBTAIN CLARIFICATION FROM BUILDING OWNER REGARDING AVAILABILITY OF PRE-STOCKED OR INVENTORIES BUILDING MATERIALS (IF ANY) THAT MAY BE CONSIDERED FOR THIS PROJECT.
7. HATCHED AREA ON PLAN DRAWING IS "NOT IN CONTRACT" BASE BUILDING SPACES AND CONSTRUCTION EXIST STAIRS, SHIFTS, ELECTRICAL, TOILETS, ETC) ARE SHOWN FOR REFERENCE ONLY UNLESS NOTED OTHERWISE.
8. WHERE THE DESIGN INTENT CANNOT BE DETERMINED FROM CONSTRUCTION DOCUMENTS, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO PROCEEDING WITH CONSTRUCTION.
9. PATCH AND REPAIR EXISTING PARTITIONS WHERE DEMOLITION HAS OCCURRED, INCLUDING THE REMOVAL OF WALL, OUTLETS, WALL BASE, BLANK COVER PLATES, AND THERMOSTATS. REPAIR GYPSUM BOARD AND PREPARE FOR SPECIFIED FINISH.
10. WHERE NEW ELEMENTS ARE ADJACENT TO EXISTING ELEMENTS, ALIGN FINISHED SURFACES, UNO.
11. PROVIDE CLEAN TRANSITIONS BETWEEN VERTICAL SURFACES. USE TRIM PIECES AT MATERIAL TRANSITIONS.
12. NOTIFY ARCHITECT OF ANY AREAS WHERE DIMENSIONAL REQUIREMENTS CANNOT BE MET OR EXCEED DIMENSIONS SHOWN FOR CLARIFICATION.
13. PAINT ALL EXPOSED DECK, PIPES, DUCTWORK, AIR DIFFUSERS, AND GRILLS, AND ACCESS DOORS TO MATCH COLOR OF ADJACENT CEILING OR WALL SURFACE, UNO.
14. ALL DIMENSIONS ON FINISH PLANS ARE TO FINISHED FACE OF MATERIAL, UNO.
15. PAINT ALL COUNTERTOP SUPPORT BRACES TO MATCH ADJACENT WALL SURFACE UNLESS FACTORY FINISHED.
16. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES IN GYP WALL BOARD TO MATCH ADJACENT WALL COLOR, UNO. RE: DOOR SCHEDULE
17. REFER TO ELEVATIONS AND REFLECTED CEILING PLAN FOR ADDITIONAL INFORMATION RELATED TO FINISHES AND EXTENTS.
18. TRENCHING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSCRIBING OF CONCRETE IRREGULARITIES.
19. ALL FLOORING MATERIALS AND TRANSITIONS SHALL BE CENTERED UNDER THE DOOR IN THE CLOSED POSITION UNO.
20. CONTRACTOR TO SUBMIT INSTALLATION PATTERN DRAWINGS FOR ARCHITECT'S APPROVAL FOR ALL APPLICABLE FINISHES (INCLUDING BUT NOT LIMITED TO: CARPET, TILE, FLUID APPLIED FLOORING).
21. FLOORING SUBCONTRACTORS TO VERIFY ALL DIMENSIONS. SMALL FLOORING SLIVERS ALONG PERIMETER WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED.
22. PROVIDE CORNER GUARDS AT ALL GYPSUM BOARD OUTSIDE CORNERS IN PUBLIC SPACES, UNO.
23. REFER TO ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
24. THIS PLAN SHOWS LOCATIONS OF ITEMS IN ARCHITECTURALLY SIGNIFICANT SPACES ONLY. REFER TO PLUMBING, MECHANICAL AND ELECTRICAL PLANS FOR ALL ITEMS NOT SHOWN.
25. CENTER ALL CEILING MOUNTED ITEMS LOCATED IN ACT, GYPSUM BOARD SOFFITS / CEILINGS AND BETWEEN OTHER CEILING MOUNTED FIXTURES.
26. ALL CEILING ELEVATION REFERENCES ARE RELATIVE TO FINISHED FLOOR SLAB BELOW.
27. CONTRACTOR TO FIELD VERIFY CONDITIONS ABOVE FINISHED CEILING AND CEILING HEIGHT RESTRICTIONS. COORDINATE WITH ARCHITECT.
28. ALL NEW AND EXISTING TO REMAIN GYP. BOARD CEILINGS, SOFFITS, AND HEADERS TO BE PAINTED EP-1 UNO.
29. ALL EXPOSED CEILING STRUCTURE AND DECK TO BE PAINTED, UNO.

CONSTRUCTION PLAN LEGEND

-  EXISTING WALL TO REMAIN
-  NEW STUD WALL FRAMING - TO BOTTOM OF CEILING
-  AREA NOT IN CONTRACT (N.I.C.)
-  EXISTING DOOR TO REMAIN
-  NEW DOOR WITH DOOR TAG OR EXISTING DOOR TO BE REUSED; RE: DOOR SCHEDULE
-  EQUIPMENT / ACCESSORY / MATERIAL TAG (ALSO ON INTERIOR ELEVATIONS)
-  NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF METAL DECK
-  NEW WALL PARTITION TAG MASONRY/GYPSUM TO BOTTOM OF CEILING
-  SYSTEM ASSEMBLY TYPE: FLOORS, WALLS, CEILINGS, AND ROOFS

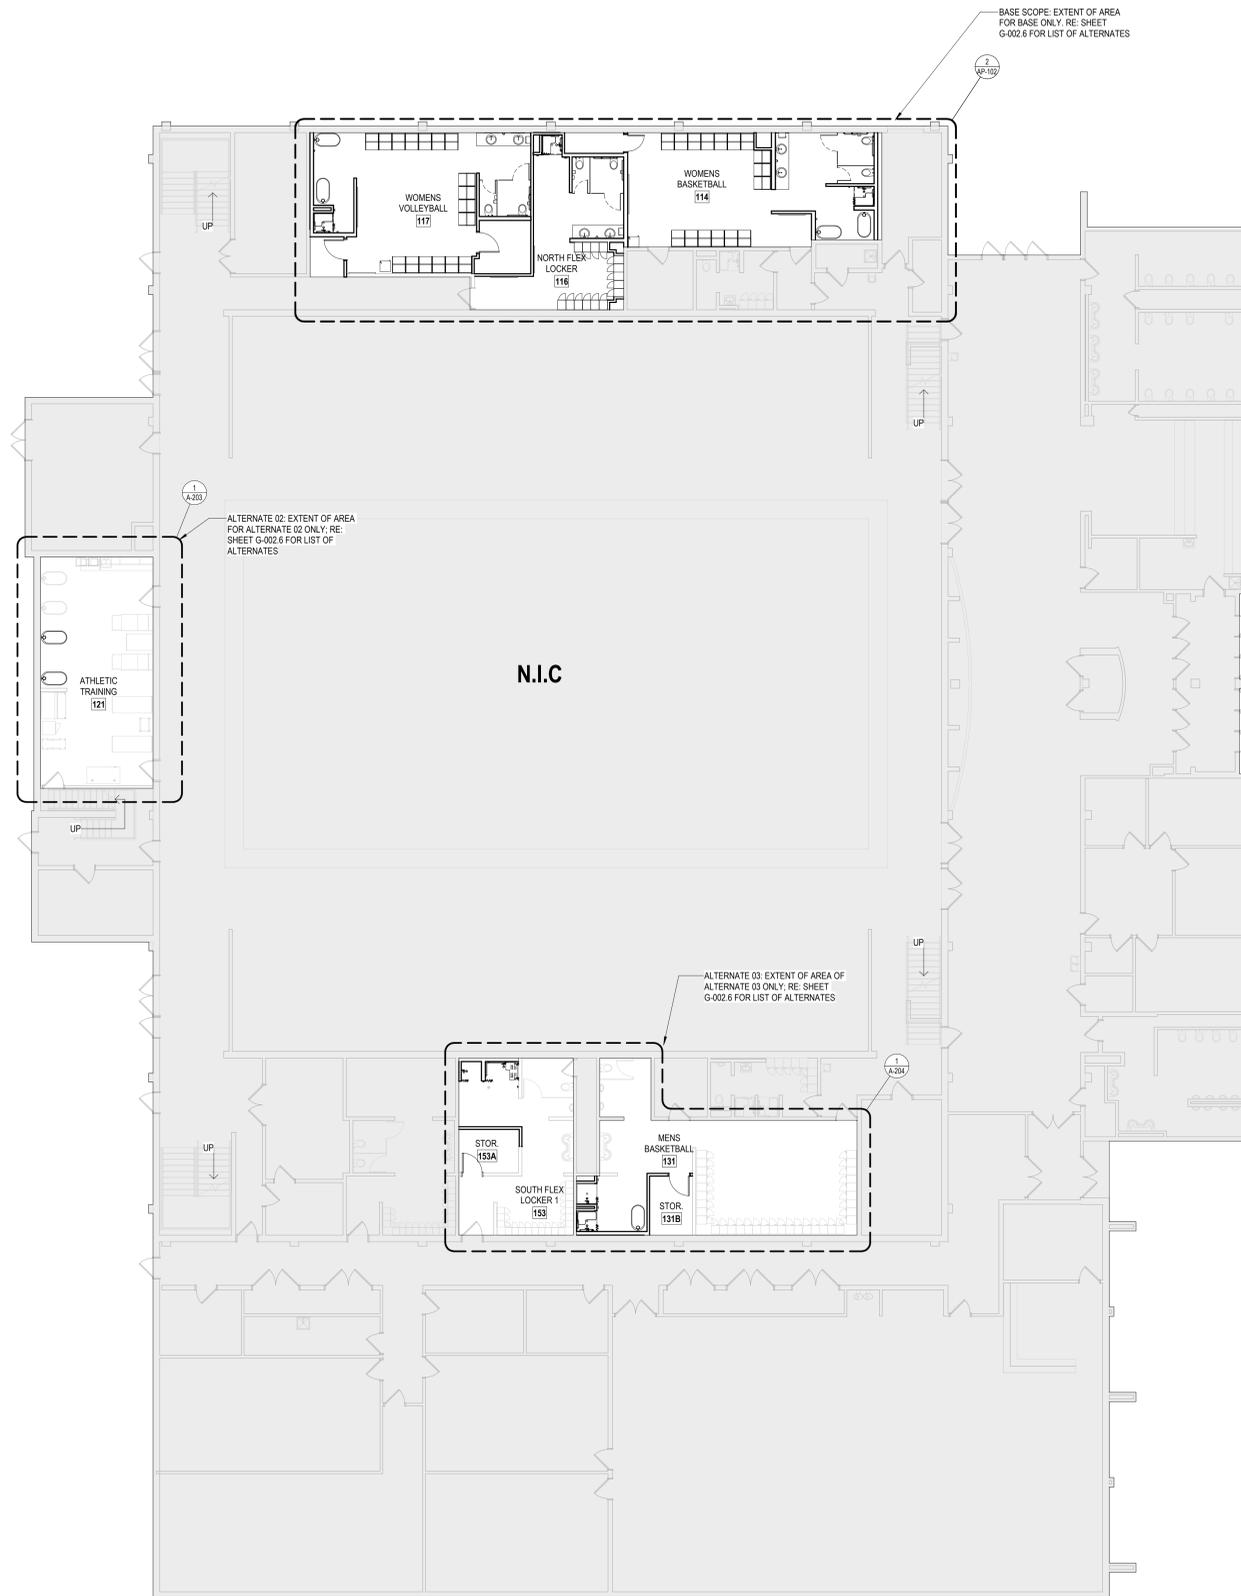

1 OVERALL FLOOR PLAN
3/32" = 1'-0"



REVISION	DATE
Addendum 01	2024-03-06

FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2024-02-13
Drawn By	BD
Checked By	Checker

Copyright:
ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE


Sheet Name
LEVEL 1 OVERALL FLOOR PLAN

A-101

ACCESSORY GENERAL NOTES

- REFER TO ARCHITECTURAL ENLARGED PLANS, FINISH PLANS, AND REFLECTED CEILING PLANS IN COORDINATION WITH ALL CONSULTANT DRAWINGS FOR COMPLETE REQUIREMENTS.
- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING POWER AND COMMUNICATION DEVICES TO REMAIN, RELOCATE, OR REMOVE, WHETHER OR NOT SHOWN ON ARCHITECTURAL DRAWINGS. NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO ROUGH-IN.
- ALL POWER, COMMUNICATION, AND LOW-VOLTAGE DEVICES SHOWN ARE NEW UNLESS NOTED AS EXISTING TO REMAIN OR TO BE REMOVED.
- UNLESS NOTED OTHERWISE, INSTALL WALL-MOUNTED POWER AND COMMUNICATION DEVICES AT 48" AFF TO CENTERLINE, VERTICALLY ORIENTED. COORDINATE EXACT MOUNTING HEIGHTS AND LOCATIONS WHERE DEVICES ARE GROUPED OR INTEGRATED WITH FURNITURE, MILLWORK, EQUIPMENT, OR ACCESSORIES.
- PROVIDE CONTINUOUS SOLID BLOCKING IN WALLS FOR ALL WALL-MOUNTED EQUIPMENT, DEVICES, FURNITURE SYSTEMS, ACCESSORIES, AND TECHNOLOGY COMPONENTS, NO EXCEPTIONS.
- COORDINATE FINAL LOCATIONS, QUANTITIES, AND ROUGH-IN REQUIREMENTS FOR ALL SHIELD LOCKER SYSTEM WITH TENANT'S LOCKER VENDOR PRIOR TO ROUGH-IN.
- ALL UPS-BACKED RECEPTACLES SHALL BE CLEARLY IDENTIFIED WITH PERMANENTLY AFFIXED LABELS. COORDINATE FINAL LABELING REQUIREMENTS WITH TENANT'S IT PROVIDER.
- COORDINATE APPLIANCE POWER, DATA, PLUMBING CONNECTIONS, CLEARANCES, VENTILATION, AND MOUNTING HEIGHTS WITH ARCHITECTURAL DRAWINGS, MILLWORK SHOP DRAWINGS, AND EQUIPMENT SPECIFICATIONS.
- COORDINATE POWER AND DATA FOR WALL-MOUNTED EQUIPMENT AND SPECIALTY DEVICES, TO ALIGN WITH ARCHITECTURAL ELEVATIONS, FURNITURE LAYOUTS, AND MILLWORK.
- REPAIR, PATCH, AND REFINISH ALL WALL, CEILING, AND FLOOR SURFACES IMPACTED BY REMOVAL, RELOCATION, OR ABANDONMENT OF POWER AND COMMUNICATION DEVICES TO MATCH ADJACENT FINISHES.
- PROVIDE DEVICE FINISHES TO MATCH ARCHITECTURAL STANDARDS, UNLESS NOTED OTHERWISE. PROVIDE WHITE FINISH FOR RECEPTACLES, SWITCHES, DIMMERS, DATA PLATES, THERMOSTATS, AND SIMILAR DEVICES.
- COORDINATE LOCATIONS OF LIFE-SAFETY DEVICES: EXIT SIGNAGE, EMERGENCY LIGHTING, THERMOSTATS, SPEAKERS, SPRINKLER HEADS, AND DIFFUSERS WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH-IN. NOTIFY ARCHITECT OF CONFLICTS WITH DESIGN INTENT.
- WHERE PERMITTED BY CODE AND AHJ, PROVIDE LIFE-SAFETY AND LOW-PROFILE DEVICES IN FINISHES TO MATCH ADJACENT CONSTRUCTION IN CRITICAL DESIGN AREAS. COORDINATE WITH ARCHITECT PRIOR TO INSTALLATION.
- NOTIFY ARCHITECT OF ANY CONDITIONS WHERE REQUIRED POWER, DATA, OR COMMUNICATION CLEARANCES CANNOT BE ACHIEVED PRIOR TO CONSTRUCTION.
- ALIGN FINISHED SURFACES WHERE NEW CONSTRUCTION ABUTS EXISTING UNLESS NOTED OTHERWISE.
- CONFIRM AVAILABILITY OF ANY OWNER PRE-STOCKED OR INVENTORIED MATERIALS.
- WHERE DESIGN INTENT IS UNCLEAR, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO CONSTRUCTION.
- NOTIFY ARCHITECT IMMEDIATELY IF DIMENSIONAL OR COORDINATION REQUIREMENTS CANNOT BE MET.

TYPICAL DEVICE MOUNTING

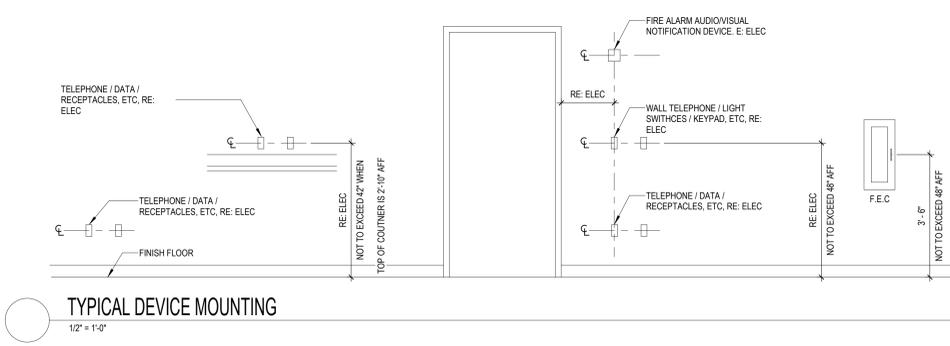

EQUIPMENT & ACCESSORIES


MARK	ACCESSORY	MANUFACTURER	MODEL NO.	INFRASTRUCTURE REQUIREMENTS					RESPONSIBILITY	NOTES
				BLOCKING	PLUMBING	POWER	DATA			
EQ-1	REFRIGERATOR			NO	NO	YES	NO	CFCI	PROVIDE POWER AT PROPOSED FRIDGE LOCATIONS	
EQ-2	WHIRLPOOL COLD TUB	WHITEHALL	WHIS-90-SL & WHTA-25-M	NO	YES	YES	NO	CFCI	INCLUDES WHIRLPOOL TUB AND MOBILE TURBINE	
EQ-3	LCS DELUXE PORCELAIN WHITEBOARD 72" X 48" & 48" X 48"	CLARIDGE	LCS2044R	YES	NO	NO	NO	CICI	COLOR: 100 WHITE; INCLUDE MAGNETIC STADIUM MARKER CADDY MGM-C1-S	
EQ-4	TA-WALL 48" X 48"	KOROSEAL		YES	NO	NO	NO	CFCI	CONFIRM FINAL LOCATION WITH OWNER	
EQ-5	DAKTRONIC CLOCK	DAKTRONIC	TI-3031	YES	NO	YES	YES	CFCI	PROVIDE ALLOWANCE FOR INSTALLATION OF NINE DEVICES; FINAL LOCATIONS AND MOUNTING HEIGHT TO BE DETERMINED BY OWNER	

TOILET BATH ACCESSORIES

MARK	ACCESSORY	MANUFACTURER	MODEL NO.	MOUNTING HEIGHT	NOTES
TA-1	CLASSIC SERIES 8" SURFACE-MOUNTED SOAP DISPENSER	BOBRICK	B-2111	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-2	WELDED FRAME MIRROR 24" X 36"	BOBRICK	B-290 2436	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-3	DOUBLE ROBE HOOK	BOBRICK	B-672 SERIES	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-4	AUTOMATIC UNIVERSAL ROLL PAPER TOWEL DISPENSER	BOBRICK	B-2974	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-5	SANITARY NAPKIN DISPOSAL	BOBRICK	B-270	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-6	MULTI-ROLL TOILET TISSUE DISPENSER	BOBRICK	B-4288	REFER TO MOUNTING HEIGHT SCHEDULE	
TA-8	TOILET PARTITIONS	INPRO	RE: SPEC SECTION 10 2113	FLOOR MOUNTED OVERHEAD-BRACED SHOWER PARTITIONS	COLOR: FROSTED WHITE P9711
TA-9	SHOWER CURTAIN SYSTEM 36" KIT	INPRO	ENSSBSCRNTKIT-36	REFER TO ELEVATIONS	
TA-10	SHOWER CURTAIN SYSTEM 60" KIT	INPRO	ENSSBSCRNTKIT-60	REFER TO ELEVATIONS	
TA-11	TWO-WALL GRAB BAR (SHOWER B)	BOBRICK	B-58616 99 X 24.36	ICCANSI A117.1-2003 FIG. 604.5.1	1-1/4" DIAMETER
TA-12	FOLDING L-SHAPE PHENOLIC SEAT WITH LEGS - RIGHT	INPRO	DSG8FLDSST-RH	REFER TO MOUNTING HEIGHT SCHEDULE	COLOR: WHITE
TA-13	GRAB BAR ASSEMBLY (TOILET)	BOBRICK	B-6806 X 42.36.18	ICCANSI A117.1-2003 FIG. 604.5.1	
TA-14	GRAB BAR ASSEMBLY (SHOWER A)	BOBRICK	B-6806 X 24.18.18	ICCANSI A117.1-2003 FIG. 604.5.1	<varies>

TOILET AND BATH ACCESSORIES

GRAPHICS FROM ANSI STANDARD ACCESSIBLE AND USEABLE BUILDINGS AND FACILITIES (ICC A117.1-2017)

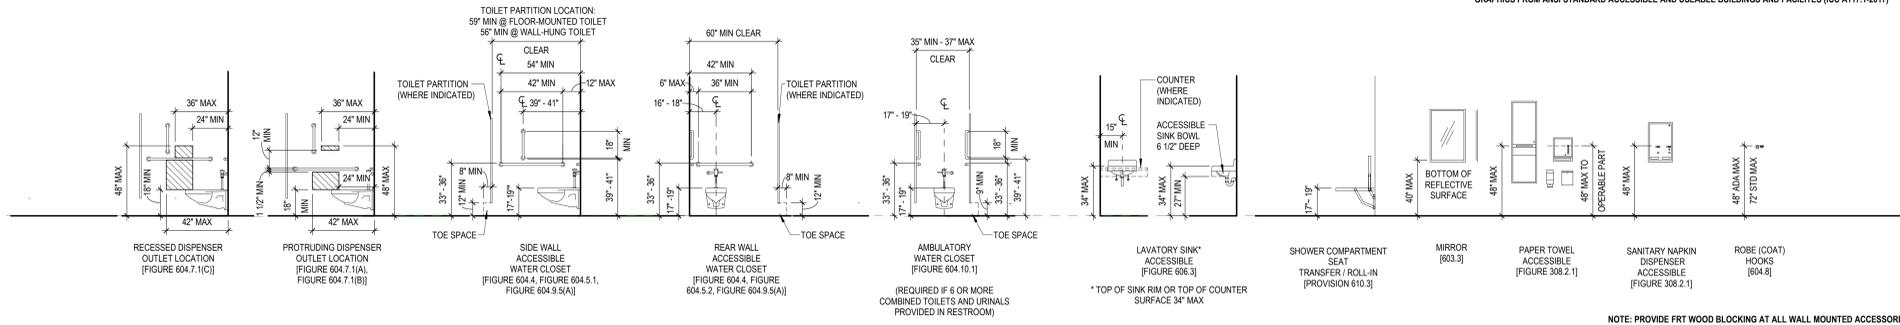

Revision 01	2026-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2026-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE
Sheet Name	ACCESSORIES INFORMATION

SHEET KEYNOTES

- NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SHIPPED ON ANY GIVEN DRAWING SHEET.
- 101 EXISTING MECHANICAL LOUVER, RE: MECHANICAL
 - 102 SHIELD LOCKER, OFCI PROVIDE ALL NECESSARY UTILITY REQUIREMENTS AND MOUNTING REQUIREMENTS
 - 103 EXISTING LOCKER, OFCI
 - 104 WATER JET OUT LVT IN THE SHAPE OF THE THUNDER BIRD LOGO; BASE BID ONLY FILE FRO MANUFACTURER WILL BE PROVIDED TO INSTALLER FOR EXACT CUTOUT INFORMATION
 - 105 NEW LOUVER IN EXISTING WINDOW OPENING, RE: MECHANICAL
 - 110 EXISTING DOOR TO REMAIN; PROTECT DURING DEMOLITION AND CONSTRUCTION
 - 111 RECESSED LINEAR LUMINAIRE LIGHT FIXTURE, RE: ELECTRICAL
 - 114 INFILL WITH NEW MASONRY UNITS. MATCH INTERIOR AND EXTERIOR MASONRY, GROUT AND FINISH
 - 115 PENDANT LINEAR LUMINAIRE LIGHT FIXTURE, RE: ELECTRICAL

CONSTRUCTION GENERAL NOTES

- SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION
1. INTERIOR BUILDING DIMENSIONS ARE TO GRID CENTERLINE AND FACE OF STUD FRAMING AT NEW CONSTRUCTION AND FROM FACE OF EXISTING BUILDING ELEMENT TO FACE OF STUD, UNO.
 2. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORIES; NO EXCEPTIONS.
 3. ALL INTERIOR FRAMED WALL ASSEMBLIES TO BE TYPE P3 TO BOTTOM OF DECK, UNO.
 4. ALL INTERIOR MASONRY WALL ASSEMBLIES ARE EXISTING, UNO.
 5. OBTAIN CLARIFICATION FROM BUILDING OWNER REGARDING AVAILABILITY OF PRE-STOCKED OR INVENTORIED BUILDING MATERIALS (IF ANY) THAT MAY BE CONSIDERED FOR THIS PROJECT.
 6. HATCHED AREA ON PLAN DRAWING IS NOT IN CONTRACT. BASE BUILDING SPACES AND CONSTRUCTION (EXIT STAIRS, SHAFTS, ELECTRICAL, TOILETS, ETC.) ARE SHOWN FOR REFERENCE ONLY UNLESS NOTED OTHERWISE.
 7. WHERE THE DESIGN INTENT CANNOT BE DETERMINED FROM CONSTRUCTION DOCUMENTS, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO PROCEEDING WITH CONSTRUCTION.
 8. PATCH AND REPAIR EXISTING PARTITIONS WHERE DEMOLITION HAS OCCURRED, INCLUDING THE REMOVAL OF WALL OUTLETS, WALL BASE, BLANK COVER PLATES, AND THERMOSTATS. REPAIR GYPSUM BOARD AND PREPARE FOR SPECIFIED FINISH.
 9. WHERE NEW ELEMENTS ARE ADJACENT TO EXISTING ELEMENTS, ALIGN FINISHED SURFACES, UNO.
 10. PROVIDE CLEAN TRANSITIONS BETWEEN VERTICAL SURFACES. USE TRIM PIECES AT MATERIAL TRANSITIONS.
 11. NOTIFY ARCHITECT OF ANY AREAS WHERE DIMENSIONAL REQUIREMENTS CANNOT BE MET OR EXCEED DIMENSIONS SHOWN FOR CLARIFICATION.
 12. PAINT ALL EXPOSED DECK, PIPES, DUCTWORK, AIR DIFFUSERS, AND GRILLS, AND ACCESS DOORS TO MATCH COLOR OF ADJACENT CEILING OR WALL SURFACE, UNO.
 13. ALL DIMENSIONS ON FINISH PLANS ARE TO FINISHED FACE OF MATERIAL, UNO.
 14. PAINT ALL COUNTERTOP SUPPORT BRACES TO MATCH ADJACENT WALL SURFACE UNLESS FACTORY FINISHED.
 15. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES IN GYP WALL BOARD TO MATCH ADJACENT WALL COLOR, UNO. RE: DOOR SCHEDULE
 16. REFER TO ELEVATIONS AND REFLECTED CEILING PLAN FOR ADDITIONAL INFORMATION RELATED TO FINISHES AND EXTENTS.
 17. TRENCHING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSIRRULARITIES OF CONCRETE IRREGULARITIES.
 18. ALL FLOORING MATERIALS AND TRANSITIONS SHALL BE CENTERED UNDER THE DOOR IN THE CLOSED POSITION UNO.
 19. CONTRACTOR TO SUBMIT INSTALLATION PATTERN DRAWINGS FOR ARCHITECT'S APPROVAL FOR ALL APPLICABLE FINISHES (INCLUDING BUT NOT LIMITED TO CARPET, TILE, FLUID APPLIED FLOORING).
 20. FLOOR FINISHES TO EXTEND UNDER CASEWORK AND KNEE SPACE, UNO
 21. FLOORING SUBCONTRACTORS TO FIELD VERIFY ALL DIMENSIONS. SMALL FLOORING SLIVERS ALONG PERIMETER WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED.
 22. PROVIDE CORNER GUARDS AT ALL GYPSUM BOARD OUTSIDE CORNERS IN PUBLIC SPACES, UNO.
 23. REFER TO ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
 24. THIS PLAN SHOWS LOCATIONS OF ITEMS IN ARCHITECTURALLY SIGNIFICANT SPACES ONLY. REFER TO PLUMBING, MECHANICAL AND ELECTRICAL PLANS FOR ALL ITEMS NOT SHOWN.
 25. CENTER ALL CEILING MOUNTED ITEMS LOCATED IN ACT, GYPSUM BOARD SOFFITS / CEILINGS AND BETWEEN OTHER CEILING MOUNTED FIXTURES.
 26. ALL CEILING ELEVATION REFERENCES ARE RELATIVE TO FINISHED FLOOR SLAB BELOW.
 27. CONTRACTOR TO FIELD VERIFY CONDITIONS ABOVE FINISHED CEILING AND CEILING HEIGHT RESTRICTIONS. COORDINATE WITH ARCHITECT.
 28. ALL NEW AND EXISTING TO REMAIN GYP BOARD CEILINGS, SOFFITS, AND HEADERS TO BE PAINTED EP-1 UNO
 29. ALL EXPOSED CEILING STRUCTURE AND DECK TO BE PAINTED, UNO.

CONSTRUCTION PLAN LEGEND

- EXISTING WALL TO REMAIN
- NEW STUD WALL FRAMING - TO BOTTOM OF CEILING
- AREA NOT IN CONTRACT (I.C.)
- EXISTING DOOR TO REMAIN
- NEW DOOR WITH DOOR TAG OR EXISTING DOOR TO BE REUSED; RE: DOOR SCHEDULE
- EQUIPMENT / ACCESSORY / MATERIAL TAG (ALSO ON INTERIOR ELEVATIONS)
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF METAL DECK
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF CEILING
- SYSTEM ASSEMBLY TYPE: FLOORS, WALLS, CEILINGS, AND ROOFS

CEILING TAG IDENTIFIER AND TYPE LEGEND


- XX - CEILING TYPE, RE: ASSEMBLIES
- X' - X" - CEILING HEIGHT ABOVE LEVEL
- XX - SPECIAL CEILING FINISH, RE: FINISH LEGEND
- G1 - GYPSUM BOARD CEILING/SOFFT, RE: ASSEMBLIES

CEILING SYMBOLS LEGEND


- REFER TO ENGINEERING MECHANICAL, ELECTRICAL, & FIRE PROTECTION DRAWINGS FOR ADDITIONAL INFORMATION
- - LINEAR LUMINAIRE LIGHT FIXTURE, RE: ELECTRICAL
 - - EXISTING CONCRETE T BEAMS

FINISH LEGEND


- | ROOM NAME | ROOM NUMBER | WALL FINISH MATERIAL |
|-----------|-------------|-----------------------------------|
| WF | | WALL FINISH MATERIAL |
| BF | | BASE FINISH MATERIAL |
| FF | | FLOOR FINISH MATERIAL |
| FN | | FINISH NOTE, WHERE OCCURS |
| FT | | FINISH MATERIAL TAG |
| FN | | FINISH NOTE, WHERE OCCURS |
| FD | | FINISH MATERIAL/PATTERN DIRECTION |
| FT | | FINISH MATERIAL TRANSITION |
| TME | | TO MATCH EXISTING |

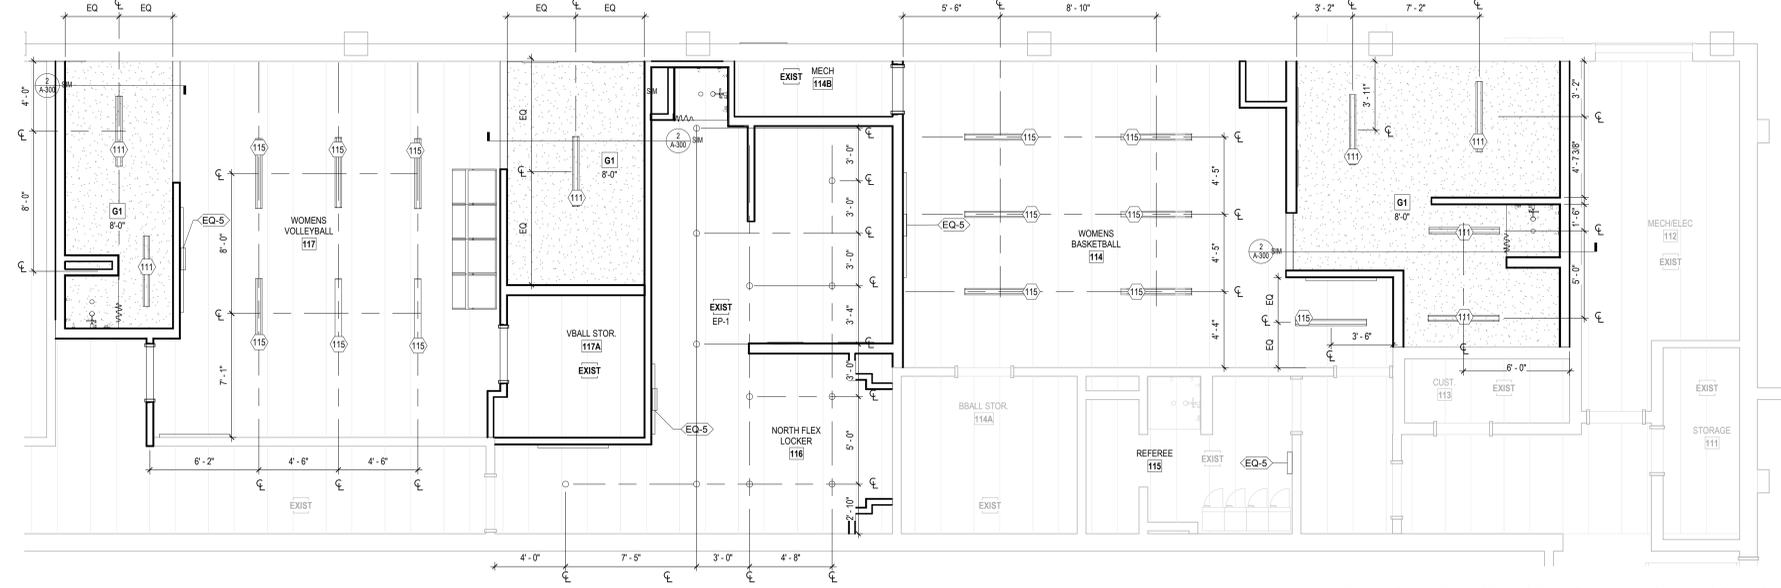


3 ENLARGED REFLECTED CEILING PLAN - NORTH LOCKERS
1/4" = 1'-0"

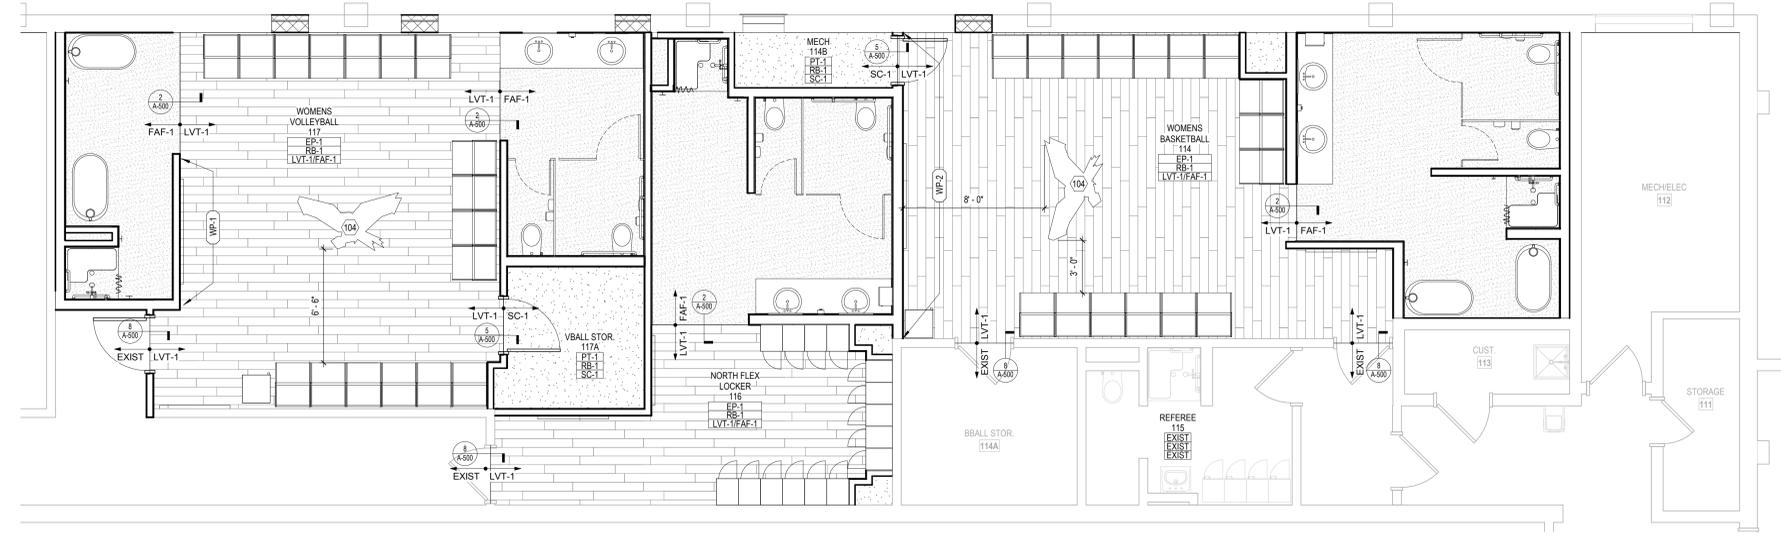

2 ENLARGED FINISH PLAN - NORTH LOCKERS
1/4" = 1'-0"

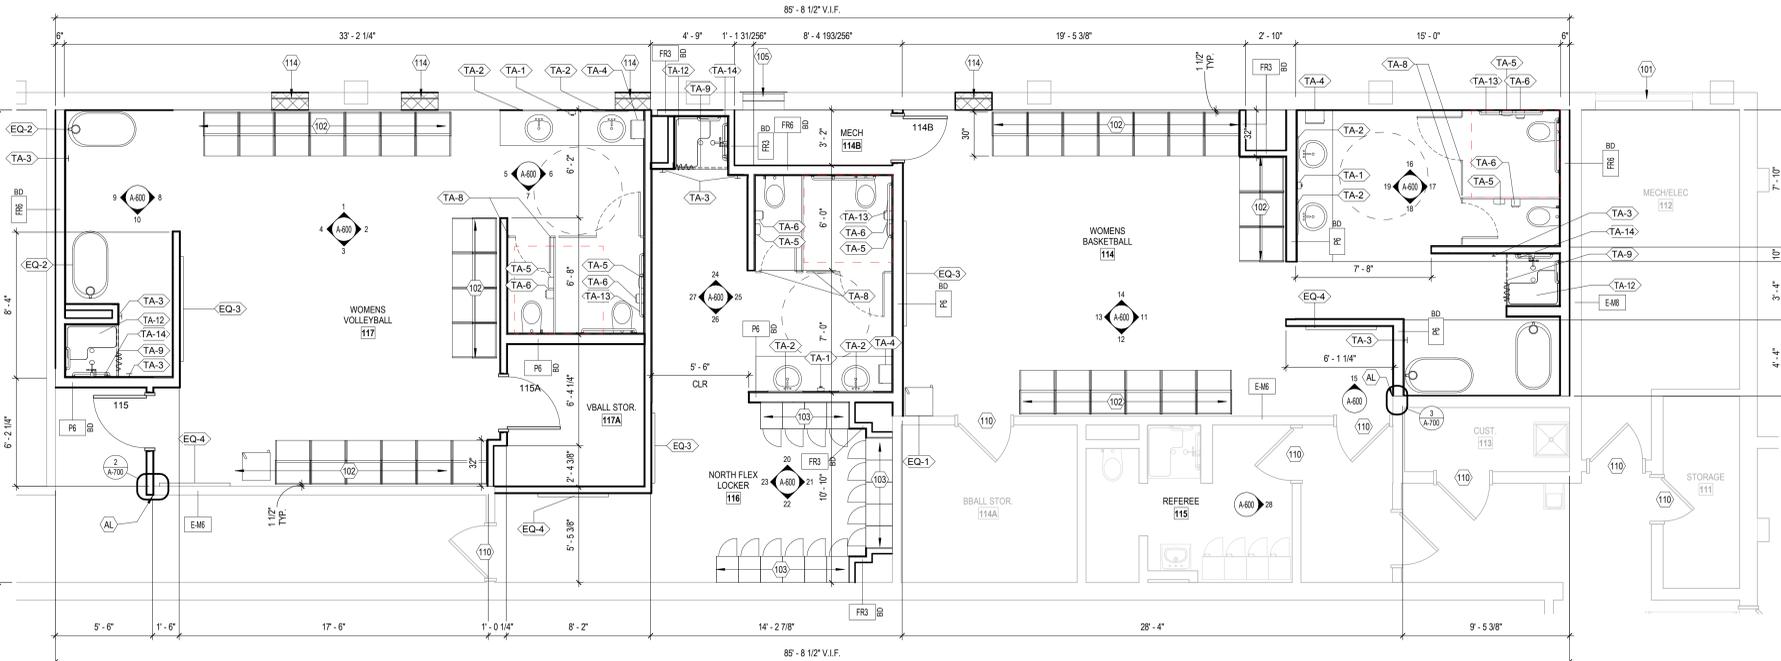


1 ENLARGED FLOOR PLAN - NORTH LOCKERS
1/4" = 1'-0"

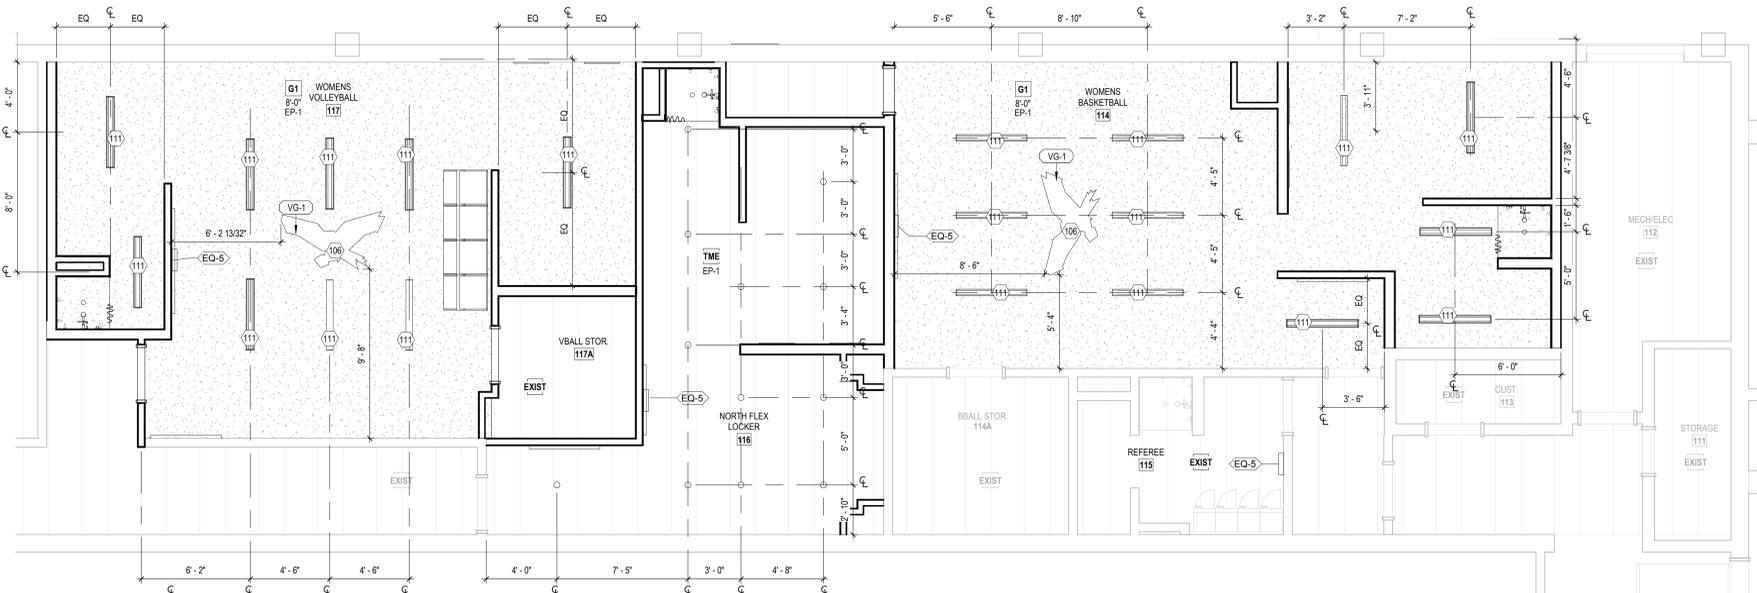

ENLARGED REFLECTED CEILING PLAN - NORTH LOCKERS ALTERNATE

2 01
1/4" = 1'-0"

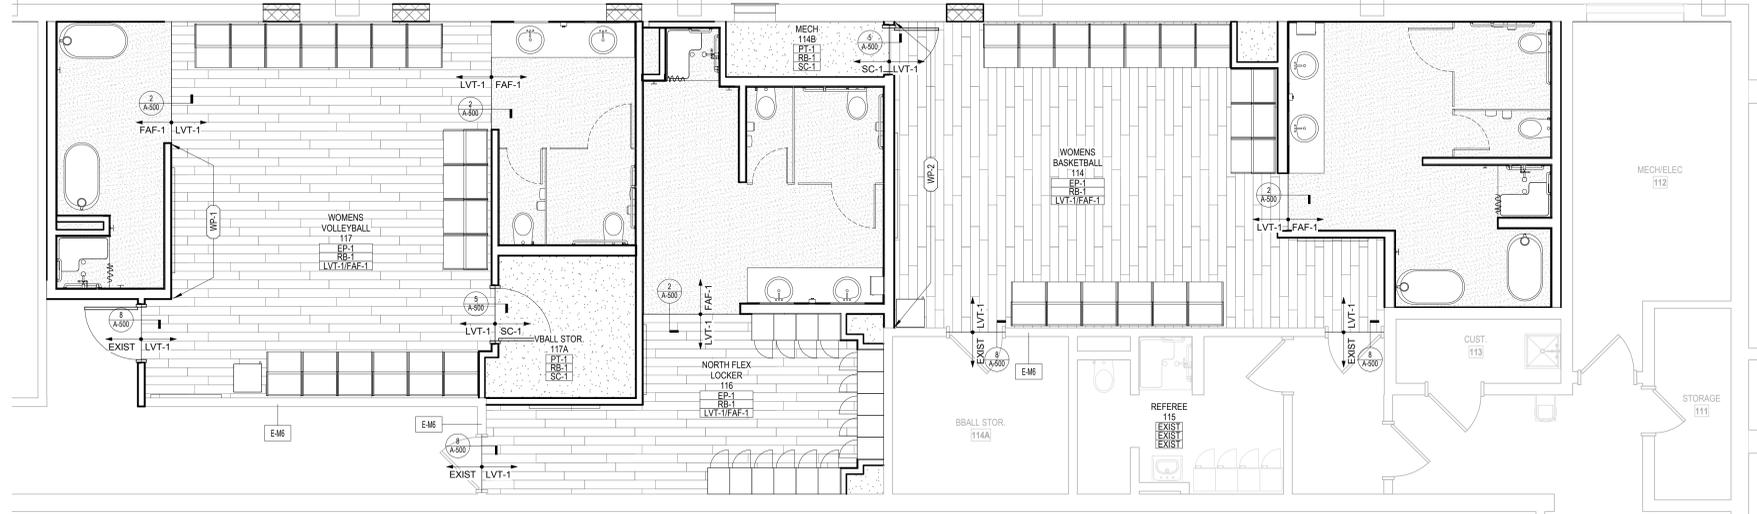

ENLARGED FINISH PLAN - NORTH LOCKERS ALTERNATE 01

1 01
1/4" = 1'-0"

○ SHEET KEYNOTES

NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SKIPPED ON ANY GIVEN DRAWING SHEET.

- 106 VINYL CEILING GRAPHIC; RE: FINISH SCHEDULE; ALTERNATE 01
- 111 RECESSED LINEAR LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL

CONSTRUCTION GENERAL NOTES

- SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION
1. INTERIOR BUILDING DIMENSIONS ARE TO GRID CENTERLINE AND FACE OF STUD FRAMING AT NEW CONSTRUCTION AND FROM FACE OF EXISTING BUILDING ELEMENT TO FACE OF STUD. UNO.
 2. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORIES. NO EXCEPTIONS.
 3. ALL INTERIOR FRAMED WALL ASSEMBLIES TO BE TYPE P3 TO BOTTOM OF DECK. UNO.
 4. ALL INTERIOR MASONRY WALL ASSEMBLIES ARE EXISTING. UNO.
 5. OBTAIN CLARIFICATION FROM BUILDING OWNER REGARDING AVAILABILITY OF PRE-STOCKED OR INVENTORIED BUILDING MATERIALS (IF ANY) THAT MAY BE CONSIDERED FOR THIS PROJECT.
 6. HATCHED AREA ON PLAN DRAWING IS NOT IN CONTRACT; BASE BUILDING SPACES AND CONSTRUCTION EXIST STAIRS, SHAFTS, ELECTRICAL, TOILETS, ETC.) ARE SHOWN FOR REFERENCE ONLY UNLESS NOTED OTHERWISE.
 7. WHERE THE DESIGN INTENT CANNOT BE DETERMINED FROM CONSTRUCTION DOCUMENTS, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO PROCEEDING WITH CONSTRUCTION.
 8. PATCH AND REPAIR EXISTING PARTITIONS WHERE DEMOLITION HAS OCCURRED, INCLUDING THE REMOVAL OF WALL OUTLETS, WALL BASE, BLANK COVER PLATES, AND THERMOSTATS. REPAIR GYPSUM BOARD AND PREPARE FOR SPECIFIED FINISH.
 9. WHERE NEW ELEMENTS ARE ADJACENT TO EXISTING ELEMENTS, ALIGN FINISHED SURFACES. UNO.
 10. PROVIDE CLEAN TRANSITIONS BETWEEN VERTICAL SURFACES. USE TRIM PIECES AT MATERIAL TRANSITIONS.
 11. NOTIFY ARCHITECT OF ANY AREAS WHERE DIMENSIONAL REQUIREMENTS CANNOT BE MET OR EXCEED DIMENSIONS SHOWN FOR CLARIFICATION.
 12. PAINT ALL EXPOSED DECK, PIPES, DUCTWORK, AIR DIFFUSERS, AND GRILLS, AND ACCESS DOORS TO MATCH COLOR OF ADJACENT CEILING OR WALL SURFACE. UNO.
 13. ALL DIMENSIONS ON FINISH PLANS ARE TO FINISHED FACE OF MATERIAL. UNO.
 14. PAINT ALL COUNTERTOP SUPPORT BRACES TO MATCH ADJACENT WALL SURFACE UNLESS FACTORY FINISHED.
 15. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES IN GYP WALL BOARD TO MATCH ADJACENT WALL COLOR. UNO. RE: DOOR SCHEDULE.
 16. REFER TO ELEVATIONS AND REFLECTED CEILING PLAN FOR ADDITIONAL INFORMATION RELATED TO FINISHES AND EXTENTS.
 17. TRENCHING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSCRIBING OF CONCRETE IRREGULARITIES.
 18. ALL FLOORING MATERIALS AND TRANSITIONS SHALL BE CENTERED UNDER THE DOOR IN THE CLOSED POSITION UNO.
 19. CONTRACTOR TO SUBMIT INSTALLATION PATTERN DRAWINGS FOR ARCHITECT'S APPROVAL FOR ALL APPLICABLE FINISHES (INCLUDING BUT NOT LIMITED TO: CARPET, TILE, FLUID APPLIED FLOORING).
 20. FLOOR FINISHES TO EXTEND UNDER CASEWORK AND KNEE SPACE. UNO.
 21. FLOORING SUBCONTRACTORS TO FIELD VERIFY ALL DIMENSIONS. SMALL FLOORING SLIVERS ALONG PERIMETER WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED.
 22. PROVIDE CORNER GUARDS AT ALL GYPSUM BOARD OUTSIDE CORNERS IN PUBLIC SPACES. UNO.
 23. REFER TO ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
 24. THIS PLAN SHOWS LOCATIONS OF ITEMS IN ARCHITECTURALLY SIGNIFICANT SPACES ONLY. REFER TO PLUMBING, MECHANICAL AND ELECTRICAL PLANS FOR ALL ITEMS NOT SHOWN.
 25. CENTER ALL CEILING MOUNTED ITEMS LOCATED IN ACT. GYPSUM BOARD SOFFITS / CEILINGS AND BETWEEN OTHER CEILING MOUNTED FIXTURES.
 26. ALL CEILING ELEVATION REFERENCES ARE RELATIVE TO FINISHED FLOOR SLAB BELOW.
 27. CONTRACTOR TO FIELD VERIFY CONDITIONS ABOVE FINISHED CEILING AND CEILING HEIGHT RESTRICTIONS. COORDINATE WITH ARCHITECT.
 28. ALL NEW AND EXISTING TO REMAIN GYP. BOARD CEILINGS, SOFFITS, AND HEADERS TO BE PAINTED EP-1 UNO.
 29. ALL EXPOSED CEILING STRUCTURE AND DECK TO BE PAINTED. UNO.

CONSTRUCTION PLAN LEGEND

- EXISTING WALL TO REMAIN
- NEW STUD WALL FRAMING - TO BOTTOM OF CEILING
- AREA NOT IN CONTRACT (N.I.C.)
- EXISTING DOOR TO REMAIN
- NEW DOOR WITH DOOR TAG OR EXISTING DOOR TO BE REUSED; RE: DOOR SCHEDULE
- EQUIPMENT / ACCESSORY / MATERIAL TAG (ALSO ON INTERIOR ELEVATIONS)
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF METAL DECK
- NEW WALL PARTITION TAG MASONRY/GYPSUM TO BOTTOM OF CEILING
- SYSTEM ASSEMBLY TYPE: FLOORS, WALLS, CEILINGS, AND ROOFS

CEILING TAG IDENTIFIER AND TYPE LEGEND

- XX - CEILING TYPE, RE: ASSEMBLIES
- X'-X" - CEILING HEIGHT ABOVE LEVEL
- XX - SPECIAL CEILING FINISH, RE: FINISH LEGEND
- G1 - GYPSUM BOARD CEILING/SOFFIT, RE: ASSEMBLIES

CEILING SYMBOLS LEGEND

- REFER TO ENGINEERING MECHANICAL, ELECTRICAL, & FIRE PROTECTION DRAWINGS FOR ADDITIONAL INFORMATION
- DOWNLIGHT LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL
 - LINEAR LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL
 - EXISTING CONCRETE T BEAMS

FINISH LEGEND

- | | |
|-------------|-----------------------------------|
| ROOM NAME | WALL FINISH MATERIAL |
| ROOM NUMBER | BASE FINISH MATERIAL |
| WF | FLOOR FINISH MATERIAL |
| BF | |
| FF | |
| XXX | FINISH NOTE, WHERE OCCURS |
| X-X | FINISH MATERIAL TAG |
| XXX | FINISH NOTE, WHERE OCCURS |
| | FINISH MATERIAL/PATTERN DIRECTION |
| X# X# | FINISH MATERIAL TRANSITION |
| TME | TO MATCH EXISTING |



Addendum 01	2026-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2026-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE

Sheet Name
ENLARGED PLAN
- NORTH
LOCKERS
ALTERNATE 01



MOA ARCHITECTURE
WYOMING | COLORADO
259 S. CENTER STREET, SUITE 206
CASPER, WYOMING 82601
307.268.9890
moaarch.com

CASPER COLLEGE LOCKER ROOMS
1944 LISCO DR, CASPER, WY 82601

○ SHEET KEYNOTES

NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SKIPPED ON ANY GIVEN DRAWING SHEET.

- 107 RELOCATED EXISTING ICE MACHINE. COORDINATE ICE MACHINE DRAIN AND POWER REQUIREMENTS; RE: PLUMBING & ELECTRICAL.
- 108 PROVIDE NEW AND EXTEND EXISTING PLUMBING FROM CEILING FOR WHIRLPOOL TUBS. PATCH AND REPAIR EXISTING ACOUSTIC CEILING TILE AS REQUIRED; RE: PLUMBING
- 109 PATCH, REPAIR AND TOUCH UP PAINT WHERE NEW WALL FINISH AND EXISTING WALL FINISH JOIN
- 110 EXISTING DOOR TO REMAIN; PROTECT DURING DEMOLITION AND CONSTRUCTION
- 113 EXISTING WHIRLPOOL COLD TUB
- 116 EXISTING EQUIPMENT AND FURNISHINGS

CONSTRUCTION GENERAL NOTES






- SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION
1. INTERIOR BUILDING DIMENSIONS ARE TO GRID CENTERLINE AND FACE OF STUD FRAMING AT NEW CONSTRUCTION AND FROM FACE OF EXISTING BUILDING ELEMENT TO FACE OF STUD, UNO.
 2. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORIES; NO EXCEPTIONS.
 3. ALL INTERIOR FRAMED WALL ASSEMBLIES TO BE TYPE P3 TO BOTTOM OF DECK, UNO.
 4. ALL INTERIOR MASONRY WALL ASSEMBLIES ARE EXISTING, UNO.
 5. OBTAIN CLARIFICATION FROM BUILDING OWNER REGARDING AVAILABILITY OF PRE-STOCKED OR INVENTORIED BUILDING MATERIALS (IF ANY) THAT MAY BE CONSIDERED FOR THIS PROJECT.
 6. HATCHED AREA ON PLAN DRAWING IS "NOT IN CONTRACT". BASE BUILDING SPACES AND CONSTRUCTION (EXIT STAIRS, SHAFTS, ELECTRICAL, TOILETS, ETC.) ARE SHOWN FOR REFERENCE ONLY UNLESS NOTED OTHERWISE.
 7. WHERE THE DESIGN INTENT CANNOT BE DETERMINED FROM CONSTRUCTION DOCUMENTS, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO PROCEEDING WITH CONSTRUCTION.
 8. PATCH AND REPAIR EXISTING PARTITIONS WHERE DEMOLITION HAS OCCURRED, INCLUDING THE REMOVAL OF WALL OUTLETS, WALL BASE, BLANK COVER PLATES, AND THERMOSTATS. REPAIR GYPSUM BOARD AND PREPARE FOR SPECIFIED FINISH.
 9. WHERE NEW ELEMENTS ARE ADJACENT TO EXISTING ELEMENTS, ALIGN FINISHED SURFACES, UNO.
 10. PROVIDE CLEAN TRANSITIONS BETWEEN VERTICAL SURFACES; USE TRIM PIECES AT MATERIAL TRANSITIONS.
 11. NOTIFY ARCHITECT OF ANY AREAS WHERE DIMENSIONAL REQUIREMENTS CANNOT BE MET OR EXCEED DIMENSIONS SHOWN FOR CLARIFICATION.
 12. PAINT ALL EXPOSED DECK, PIPES, DUCTWORK, AIR DIFFUSERS, AND GRILLS, AND ACCESS DOORS TO MATCH COLOR OF ADJACENT CEILING OR WALL SURFACE, UNO.
 13. ALL DIMENSIONS ON FINISH PLANS ARE TO FINISHED FACE OF MATERIAL, UNO.
 14. PAINT ALL COUNTERTOP SUPPORT BRACES TO MATCH ADJACENT WALL SURFACE UNLESS FACTORY FINISHED.
 15. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES IN GYP WALL BOARD TO MATCH ADJACENT WALL COLOR, UNO. RE: DOOR SCHEDULE.
 16. REFER TO ELEVATIONS AND REFLECTED CEILING PLAN FOR ADDITIONAL INFORMATION RELATED TO FINISHES AND EXTENTS.
 17. TRENCHING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSCRIBING OF CONCRETE IRREGULARITIES.
 18. ALL FLOORING MATERIALS AND TRANSITIONS SHALL BE CENTERED UNDER THE DOOR IN THE CLOSED POSITION UNO.
 19. CONTRACTOR TO SUBMIT INSTALLATION PATTERN DRAWINGS FOR ARCHITECT'S APPROVAL FOR ALL APPLICABLE FINISHES (INCLUDING BUT NOT LIMITED TO CARPET, TILE, FLUID APPLIED FLOORINGS).
 20. FLOOR FINISHES TO EXTEND UNDER CASEWORK AND KNEE SPACE, UNO.
 21. FLOORING SUBCONTRACTORS TO FIELD VERIFY ALL DIMENSIONS. SMALL FLOORING SLIVERS ALONG PERIMETER WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED.
 22. PROVIDE CORNER GUARDS AT ALL GYPSUM BOARD OUTSIDE CORNERS IN PUBLIC SPACES, UNO.
 23. REFER TO ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
 24. THIS PLAN SHOWS LOCATIONS OF ITEMS IN ARCHITECTURALLY SIGNIFICANT SPACES ONLY. REFER TO PLUMBING, MECHANICAL, AND ELECTRICAL PLANS FOR ALL ITEMS NOT SHOWN.
 25. CENTER ALL CEILING MOUNTED ITEMS LOCATED IN ACT, GYPSUM BOARD SOFFITS / CEILING, AND BETWEEN OTHER CEILING MOUNTED FIXTURES.
 26. ALL CEILING ELEVATION REFERENCES ARE RELATIVE TO FINISHED FLOOR SLAB BELOW.
 27. CONTRACTOR TO FIELD VERIFY CONDITIONS ABOVE FINISHED CEILING AND CEILING HEIGHT RESTRICTIONS. COORDINATE WITH ARCHITECT.
 28. ALL NEW AND EXISTING TO REMAIN GYP. BOARD CEILINGS, SOFFITS, AND HEADERS TO BE PAINTED EP-1, UNO.
 29. ALL EXPOSED CEILING STRUCTURE AND DECK TO BE PAINTED, UNO.

CONSTRUCTION PLAN LEGEND

- EXISTING WALL TO REMAIN
- NEW STUD WALL FRAMING - TO BOTTOM OF CEILING
- AREA NOT IN CONTRACT (N.I.C.)
- EXISTING DOOR TO REMAIN
- NEW DOOR WITH DOOR TAG OR EXISTING DOOR TO BE REUSED; RE: DOOR SCHEDULE
- EQUIPMENT / ACCESSORY / MATERIAL TAG (ALSO ON INTERIOR ELEVATIONS)
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF METAL DECK
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF CEILING
- SYSTEM ASSEMBLY TYPE: FLOORS, WALLS, CEILINGS, AND ROOFS

FINISH LEGEND

- | | |
|-------------|-----------------------------------|
| ROOM NAME | WALL FINISH MATERIAL |
| ROOM NUMBER | BASE FINISH MATERIAL |
| WF | FLOOR FINISH MATERIAL |
| BF | |
| FF | |
| XXX | FINISH NOTE, WHERE OCCURS |
| (X-#) | FINISH MATERIAL TAG |
| XXX | FINISH NOTE, WHERE OCCURS |
| X-# | FINISH MATERIAL/PATTERN DIRECTION |
| X-# | FINISH MATERIAL TRANSITION |
| TME | TO MATCH EXISTING |

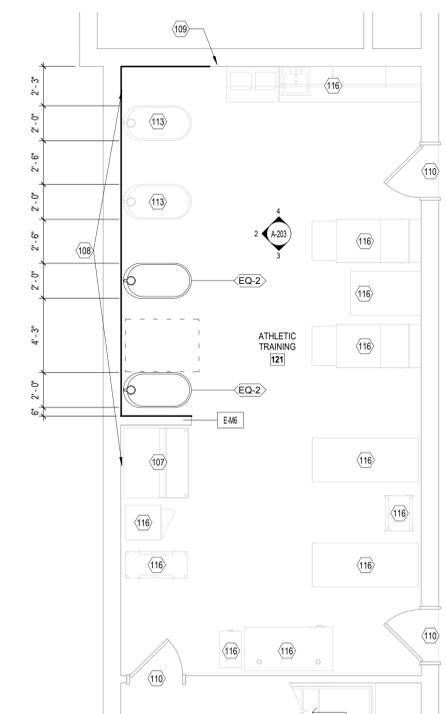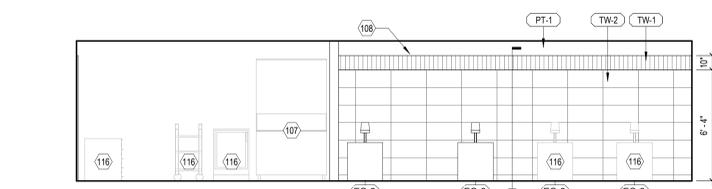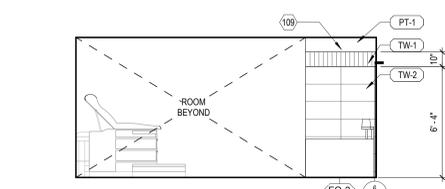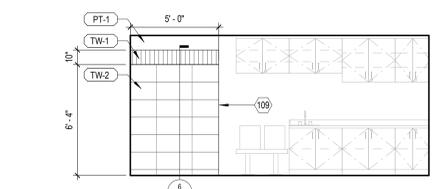

Attachment 01	2024-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2024-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE

Sheet Name
ENLARGED PLAN
- ATHLETIC
TRAINING
ALTERNATE 02

A-203


SHEET KEYNOTES

NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SKIPPED ON ANY GIVEN DRAWING SHEET.

- 110 EXISTING DOOR TO REMAIN; PROTECT DURING DEMOLITION AND CONSTRUCTION
- 111 RECESSED LINEAR LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL
- 112 NEW TILE FINISH TO WRAP CORNER OF PARTIALLY DEMOLISHED WALL AND BE FINISHED WITH SPLITTER TRIM TO MATCH DESIGN INTENT OF OTHER TILE FINISH AREAS


CONSTRUCTION GENERAL NOTES

- SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION
1. INTERIOR BUILDING DIMENSIONS ARE TO GRID CENTERLINE AND FACE OF STUD FRAMING AT NEW CONSTRUCTION AND FROM FACE OF EXISTING BUILDING ELEMENT TO FACE OF STUD UNO.
 2. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORIES. NO EXCEPTIONS.
 3. ALL INTERIOR FRAMED WALL ASSEMBLIES TO BE TYPE P3 TO BOTTOM OF DECK UNO.
 4. ALL INTERIOR MASONRY WALL ASSEMBLIES ARE EXISTING UNO.
 5. OBTAIN CLARIFICATION FROM BUILDING OWNER REGARDING AVAILABILITY OF PRE-STOCKED OR INVENTORED BUILDING MATERIALS (IF ANY) THAT MAY BE CONSIDERED FOR THIS PROJECT.
 6. HATCHED AREA ON PLAN DRAWING IS "NOT IN CONTRACT" - BASE BUILDING SPACES AND CONSTRUCTION (EXIT STAIRS, SHOWERS, ELECTRICAL, TOILETS, ETC.) ARE SHOWN FOR REFERENCE ONLY UNLESS NOTED OTHERWISE.
 7. WHERE THE DESIGN INTENT CANNOT BE DETERMINED FROM CONSTRUCTION DOCUMENTS, OBTAIN CLARIFICATION FROM ARCHITECT PRIOR TO PROCEEDING WITH CONSTRUCTION.
 8. PATCH AND REPAIR EXISTING PARTITIONS WHERE DEMOLITION HAS OCCURRED, INCLUDING THE REMOVAL OF WALL OUTLETS, WALL BASE, BLANK COVER PLATES, AND THERMOSTATS. REPAIR GYPSUM BOARD AND PREPARE FOR SPECIFIED FINISH.
 9. WHERE NEW ELEMENTS ARE ADJACENT TO EXISTING ELEMENTS, ALIGN FINISHED SURFACES UNO.
 10. PROVIDE CLEAN TRANSITIONS BETWEEN VERTICAL SURFACES. USE TRIM PIECES AT MATERIAL TRANSITIONS.
 11. NOTIFY ARCHITECT OF ANY AREAS WHERE DIMENSIONAL REQUIREMENTS CANNOT BE MET OR EXCEED DIMENSIONS SHOWN FOR CLARIFICATION.
 12. PAINT ALL EXPOSED DECK, PIPES, DUCTWORK, AIR DIFFUSERS, AND GRILLS, AND ACCESS DOORS TO MATCH COLOR OF ADJACENT CEILING OR WALL SURFACE UNO.
 13. ALL DIMENSIONS ON FINISH PLANS ARE TO FINISHED FACE OF MATERIAL UNO.
 14. PAINT ALL COUNTERTOP SUPPORT BRACES TO MATCH ADJACENT WALL SURFACE UNLESS FACTORY FINISHED.
 15. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES IN GYP WALL BOARD TO MATCH ADJACENT WALL COLOR UNO. RE: DOOR SCHEDULE.
 16. REFER TO ELEVATIONS AND REFLECTED CEILING PLAN FOR ADDITIONAL INFORMATION RELATED TO FINISHES AND EXTENTS.
 17. TRENDING FOR NEW PLUMBING SCOPE SHALL BE PATCHED TO ACCOMMODATE NEW FLOORING FINISHES WITHOUT ANY TRANSCRIBING OF CONCRETE IRREGULARITIES.
 18. ALL FLOORING MATERIALS AND TRANSITIONS SHALL BE CENTERED UNDER THE DOOR IN THE CLOSED POSITION UNO.
 19. CONTRACTOR TO SUBMIT INSTALLATION PATTERN DRAWINGS FOR ARCHITECT'S APPROVAL FOR ALL APPLICABLE FINISHES (INCLUDING BUT NOT LIMITED TO: CARPET, TILE, FLUID APPLIED FLOORING).
 20. FLOOR FINISHES TO EXTEND UNDER CASEWORK AND KNEE SPACE UNO.
 21. FLOORING SUBCONTRACTORS TO FIELD VERIFY ALL DIMENSIONS. SMALL FLOORING SLIVERS ALONG PERIMETER WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED.
 22. PROVIDE CORNER GUARDS AT ALL GYPSUM BOARD OUTSIDE CORNERS IN PUBLIC SPACES UNO.
 23. REFER TO ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
 24. THIS PLAN SHOWS LOCATIONS OF ITEMS IN ARCHITECTURALLY SIGNIFICANT SPACES ONLY. REFER TO PLUMBING, MECHANICAL AND ELECTRICAL PLANS FOR ALL ITEMS NOT SHOWN.
 25. CENTER ALL CEILING MOUNTED ITEMS LOCATED IN ACT, GYPSUM BOARD SOFFITS / CEILINGS AND BETWEEN OTHER CEILING MOUNTED FIXTURES.
 26. ALL CEILING ELEVATION REFERENCES ARE RELATIVE TO FINISHED FLOOR SLAB BELOW.
 27. CONTRACTOR TO FIELD VERIFY CONDITIONS ABOVE FINISHED CEILING AND CEILING HEIGHT RESTRICTIONS, COORDINATE WITH ARCHITECT.
 28. ALL NEW AND EXISTING TO REMAIN GYP BOARD CEILINGS, SOFFITS, AND HEADERS TO BE PAINTED EP-1 UNO.
 29. ALL EXPOSED CEILING STRUCTURE AND DECK TO BE PAINTED UNO.




Revision 01	2024-03-06
REVISION	DATE
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2024-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE


Sheet Name
ENLARGED PLAN - SOUTH LOCKER ALTERNATE 03

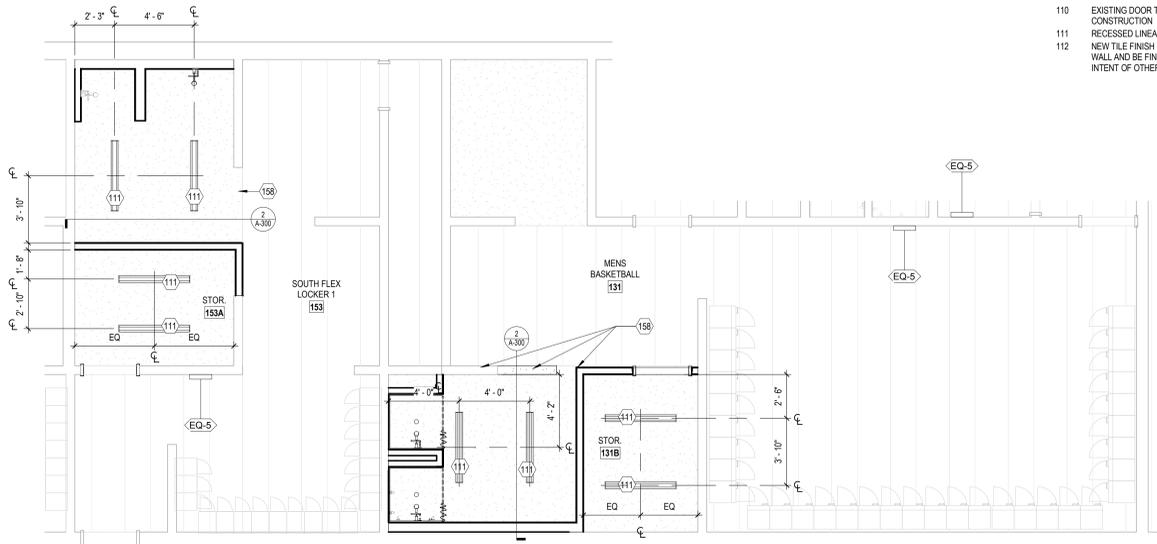

ENLARGED REFLECTED CEILING PLAN - SOUTH LOCKERS ALTERNATE 03

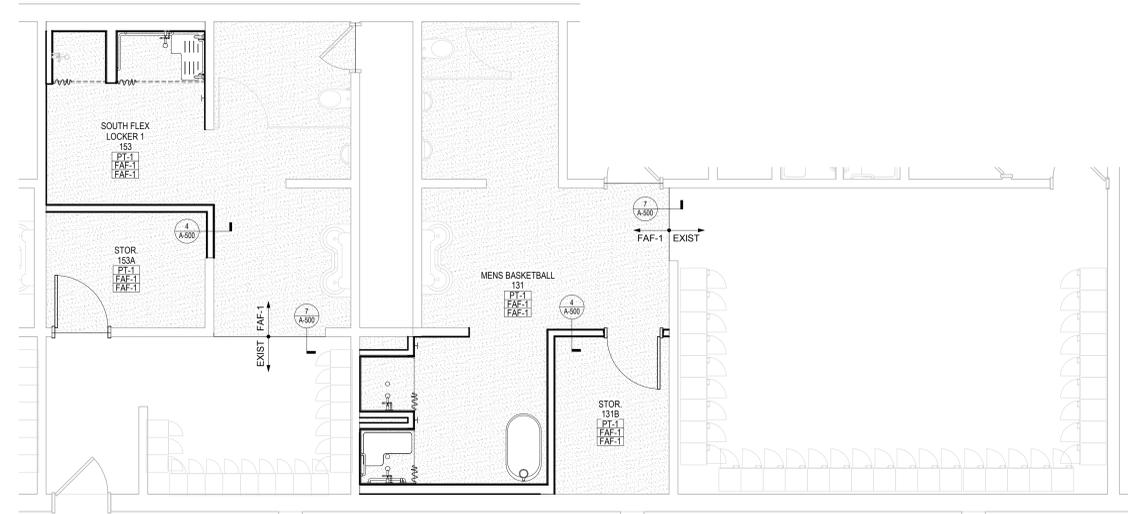

ENLARGED FINISH PLAN - SOUTH LOCKERS ALTERNATE 03

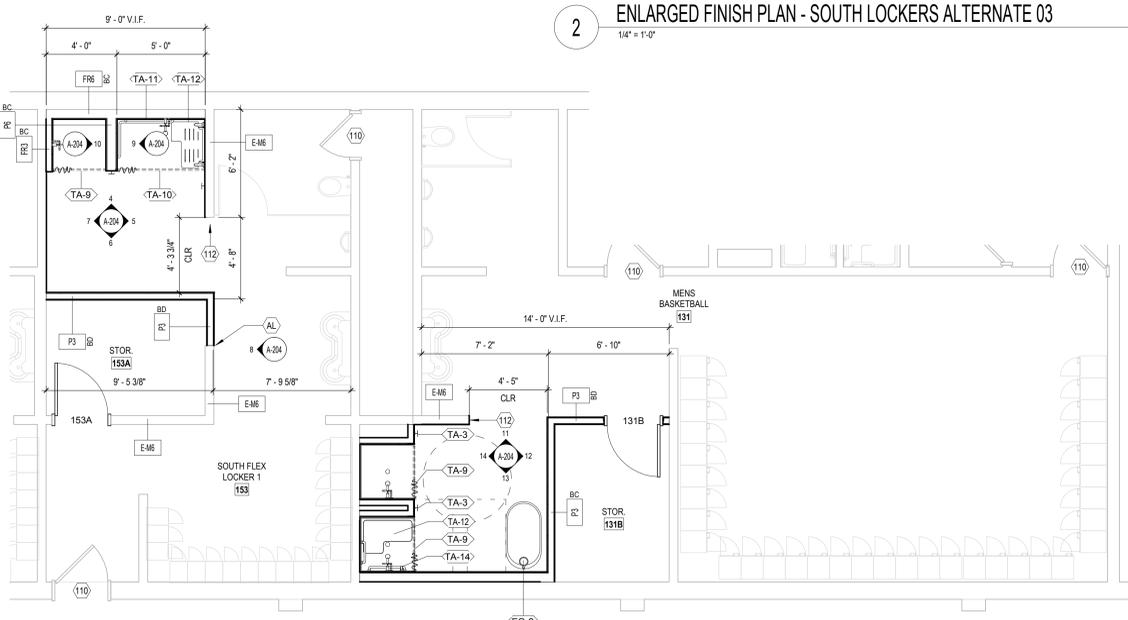

ENLARGED FLOOR PLAN - SOUTH LOCKERS ALTERNATE 03

CONSTRUCTION PLAN LEGEND

- EXISTING WALL TO REMAIN
- NEW STUD WALL FRAMING - TO BOTTOM OF CEILING
- AREA NOT IN CONTRACT (N.I.C.)
- EXISTING DOOR TO REMAIN
- NEW DOOR WITH DOOR TAG OR EXISTING DOOR TO BE REUSED; RE: DOOR SCHEDULE
- EQUIPMENT / ACCESSORY / MATERIAL TAG (ALSO ON INTERIOR ELEVATIONS)
- NEW WALL PARTITION TAG - MASONRY/GYPSUM TO BOTTOM OF METAL DECK
- NEW WALL PARTITION TAG MASONRY/GYPSUM TO BOTTOM OF CEILING
- SYSTEM ASSEMBLY TYPE: FLOORS, WALLS, CEILINGS, AND ROOFS

CEILING TAG IDENTIFIER AND TYPE LEGEND


- XX - CEILING TYPE; RE: ASSEMBLIES
- X'-X" - CEILING HEIGHT ABOVE LEVEL
- XX - SPECIAL CEILING FINISH; RE: FINISH LEGEND
- G1 - GYPSUM BOARD CEILING/SOFFIT; RE: ASSEMBLIES

CEILING SYMBOLS LEGEND


- REFER TO ENGINEERING MECHANICAL, ELECTRICAL, & FIRE PROTECTION DRAWINGS FOR ADDITIONAL INFORMATION
- DOWNLIGHT LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL
 - ▬ LINEAR LUMINAIRE LIGHT FIXTURE; RE: ELECTRICAL
 - ▬ EXISTING CONCRETE T BEAMS

FINISH LEGEND


- | ROOM NAME | ROOM NUMBER | WALL FINISH MATERIAL |
|-----------|-------------|-----------------------|
| WF | | WALL FINISH MATERIAL |
| BF | | BASE FINISH MATERIAL |
| FF | | FLOOR FINISH MATERIAL |
- XXXX FINISH NOTE, WHERE OCCURS
 - X-# FINISH MATERIAL TAG
 - XXX FINISH NOTE, WHERE OCCURS
 - FINISH MATERIAL/PATTERN DIRECTION
 - X-# X-# FINISH MATERIAL TRANSITION
 - TME TO MATCH EXISTING




14 MENS BASKETBALL 131 - W




12 MENS BASKETBALL 131 - E




10 SOUTH FLEX LOCKER RM 130 - S 2



8 SOUTH FLEX LOCKER RM 130 - W 2




6 SOUTH FLEX LOCKER RM 130 - S 1




4 SOUTH FLEX LOCKER RM 130 - N




13 MENS BASKETBALL 131 - S




11 MENS BASKETBALL 131 - N



9 SOUTH FLEX LOCKER RM 130 - E 2



7 SOUTH FLEX LOCKER RM 130 - W



5 SOUTH FLEX LOCKER RM 130 - E 1





GENERAL NOTES


SHEET SPECIFIC GENERAL INFORMATION AND/OR INSTRUCTION

1. AT ALL COUNTER MOUNTED SINKS, THE TOP OF THE SINK IS TO BE 3" MAX. COUNTER HEIGHT UNLESS NOTED OTHERWISE. SINK RIM HEIGHT WILL NEED TO BE TAKEN INTO CONSIDERATION TO ADJUST FOR APPROPRIATE COUNTER HEIGHT.
2. ALL COUNTER TOPS TO RECEIVE A 1/4" OVERHANG, TYP.
3. UNLESS NOTED OTHERWISE, ALL WALLS WITH CERAMIC TILE APPLICATION ARE TO INCLUDE A SCHLUTER TRIM TO MEET AND BE FLUSH WITH FLOOR TILE.
4. SEE A-200 FOR TOILET ACCESSORIES AND MOUNTING SCHEDULE.
5. PROVIDE BLOCKING FOR ALL WALL MOUNTED EQUIPMENT, CASEWORK AND ACCESSORY LOCATIONS, UNO.
6. ALL ELEVATION NAMES ARE REFERENCING PLAIN NORTH, SOUTH, EAST AND WEST.
7. CONTRACTOR SHALL CONFIRM CLEARANCE AND POWER REQUIREMENTS FOR ALL EQUIPMENT, TYP. PRIOR TO LAYOUT.
8. PROVIDE DRYWALL CONTROL JOINTS EVERY 30 LINEAR FEET IN UNBROKEN STRAIGHT RUNS, TYP.
9. ALL WALLS AND CEILING TO BE PAINTED WITH EP-1.
10. REFER TO SHEET A-500 FOR INTERIOR FINISH SCHEDULE. REFER TO FINISH PLAN FOR FULL EXTENT OF FINISHES.


SHEET KEYNOTES

NUMBERING IS GROUPED BY TYPE / PHASE OF WORKSHEET OF NON-ARCHITECTURAL ITEMS OR INFORMATIONAL / INSTRUCTIONAL NOTATION. SOME NUMBERS MAY BE SKIPPED ON ANY GIVEN DRAWING SHEET.


- 238 ALTERNATE 01 ONLY; SOFFIT ABOVE ALL LOCKERS IF ALTERNATE 01 IS ACCEPTED
- 239 SHIELD LOCKERS, OFCI
- 240 EXISTING LOCKERS, OFCI




Revision	2024-03-06
DATE	
FOR PERMIT AND CONSTRUCTION	
Project Number	24108.00
Date	2024-02-13
Drawn By	SZKA
Checked By	BD
Copyright:	ALL DRAWN AND WRITTEN INFORMATION APPEARING HEREIN SHALL NOT BE DUPLICATED, DISCLOSED OR OTHERWISE USED WITHOUT THE WRITTEN CONSENT OF MOA ARCHITECTURE.
Sheet Name	INTERIOR ELEVATIONS

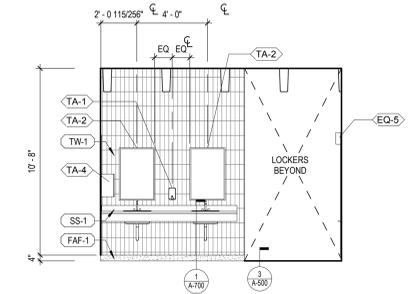


26 VISITOR LOCKER RM - SOUTH 2
1/4" = 1'-0"




27 VISITOR LOCKER RM - WEST 2
1/4" = 1'-0"




28 REFEREE 115 - EAST
1/4" = 1'-0"

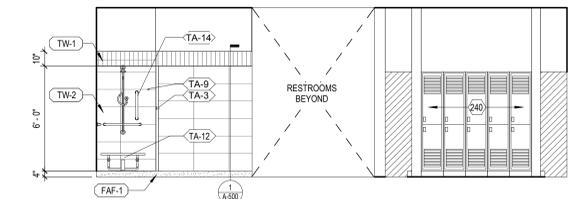


21 VISITOR LOCKER RM - EAST 1
1/4" = 1'-0"




22 VISITOR LOCKER - SOUTH 1
1/4" = 1'-0"

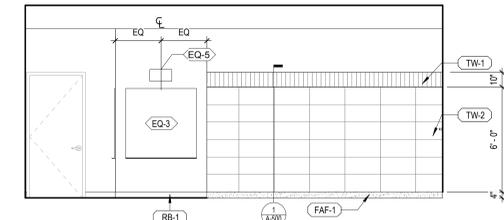


23 VISITOR LOCKER RM - WEST 1
1/4" = 1'-0"

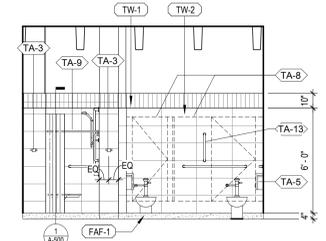


24 VISITOR LOCKER RM - NORTH 2
1/4" = 1'-0"

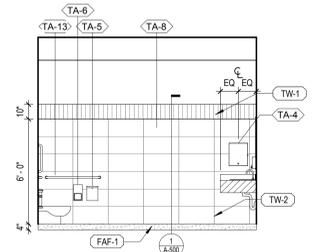


25 VISITOR LOCKER RM - EAST 2
1/4" = 1'-0"

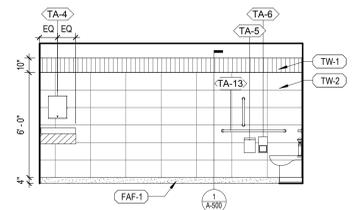


16 BASKETBALL LOCKER RM - NORTH 3
1/4" = 1'-0"

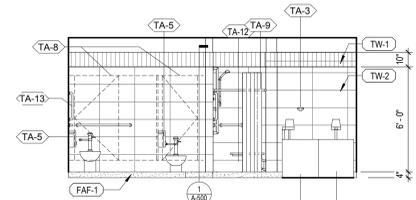


17 BASKETBALL LOCKER RM - EAST 2
1/4" = 1'-0"

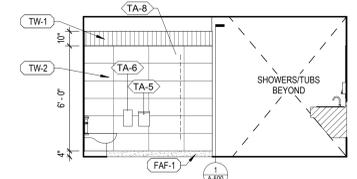


18 BASKETBALL LOCKER RM - SOUTH 2
1/4" = 1'-0"

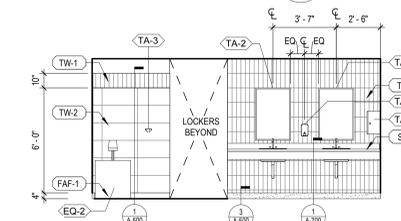


19 BASKETBALL LOCKER RM - WEST 2
1/4" = 1'-0"

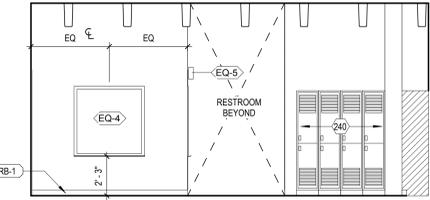


20 VISITOR LOCKER RM - NORTH 1
1/4" = 1'-0"

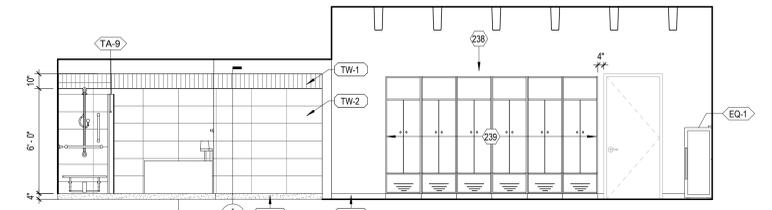


12 BASKETBALL LOCKER RM - SOUTH 1
1/4" = 1'-0"

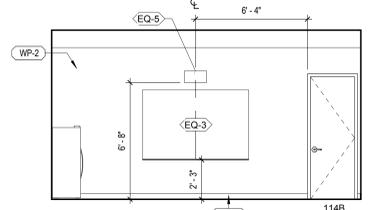


13 BASKETBALL LOCKER RM - WEST
1/4" = 1'-0"

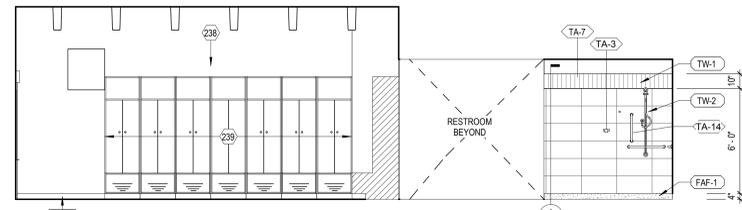


14 BASKETBALL LOCKER RM - NORTH 1
1/4" = 1'-0"




15 BASKETBALL LOCKER RM - NORTH 2
1/4" = 1'-0"

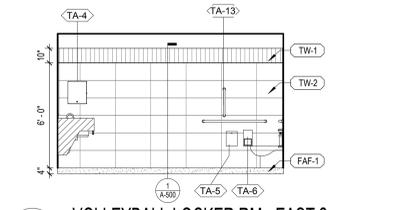


6 VOLLEYBALL LOCKER RM - EAST 2
1/4" = 1'-0"

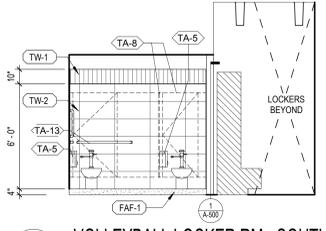


7 VOLLEYBALL LOCKER RM - SOUTH 2
1/4" = 1'-0"

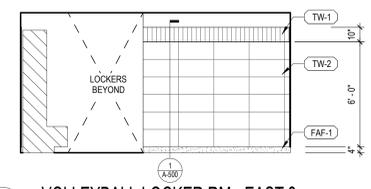


8 VOLLEYBALL LOCKER RM - EAST 3
1/4" = 1'-0"

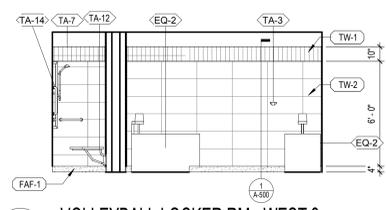


9 VOLLEYBALL LOCKER RM - WEST 3
1/4" = 1'-0"

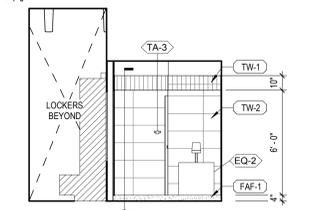


10 VOLLEYBALL LOCKER RM - SOUTH 3
1/4" = 1'-0"

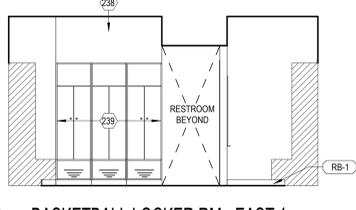


11 BASKETBALL LOCKER RM - EAST 1
1/4" = 1'-0"

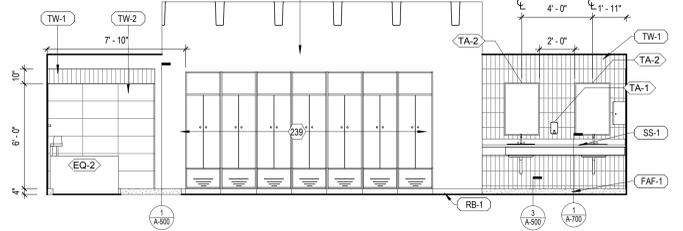


1 VOLLEYBALL LOCKER RM - NORTH
1/4" = 1'-0"

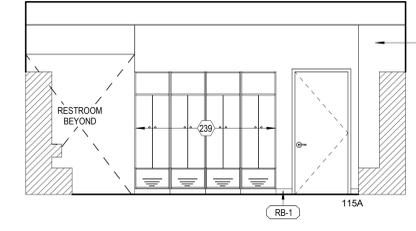


2 VOLLEYBALL LOCKER RM - EAST 1
1/4" = 1'-0"

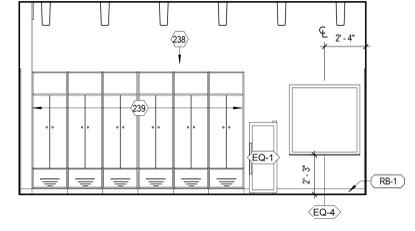

3 VOLLEYBALL LOCKER RM - SOUTH 1
1/4" = 1'-0"

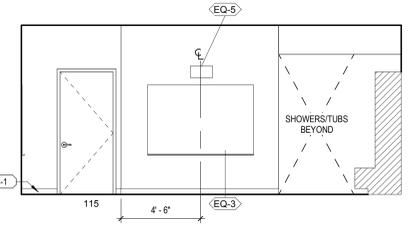

4 VOLLEYBALL LOCKER RM - WEST 1
1/4" = 1'-0"

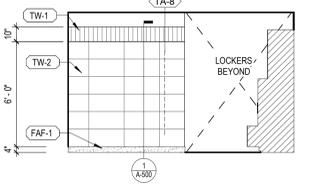

5 VOLLEYBALL LOCKER RM - WEST 2
1/4" = 1'-0"